




GENERAL NOTES

1. This drawing is to be read in conjunction with all relevant Eastwood CE drawings and specifications prefixed ECE-48176 / *****.
2. All concrete to be cured and protected from frost for a minimum of 7 days after casting.
3. Reinforcement to be Type 2 high yield steel to BS8666 2005.
4. Fabric mesh reinforcement to be Type 2 high yield steel to BS4483 2005.
5. Spacers to be individual proprietary concrete block spacers conforming to BS7973-1:2001.
6. Tying wires in exposed faces to be 1.2mm diameter stainless steel wire and 1.6mm diameter soft annealed iron wire elsewhere.
7. Cover to reinforcement : 35mm
8. Minimum lap lengths to be:
H10 - 400mm
H12 - 500mm
H16- 650mm
H20 - 800mm
H25 - 1000mm
9. Abbreviations
T1 - Top Layer of reinforcement
T2 - Second from top layer of reinforcement
B1 - Bottom layer of reinforcement
B2 - Second from bottom layer of reinforcement
10. Refer to bar bending schedules SA00394-5053-S-BLOCKA-BBS sheet 01-03 for reinforcement details.

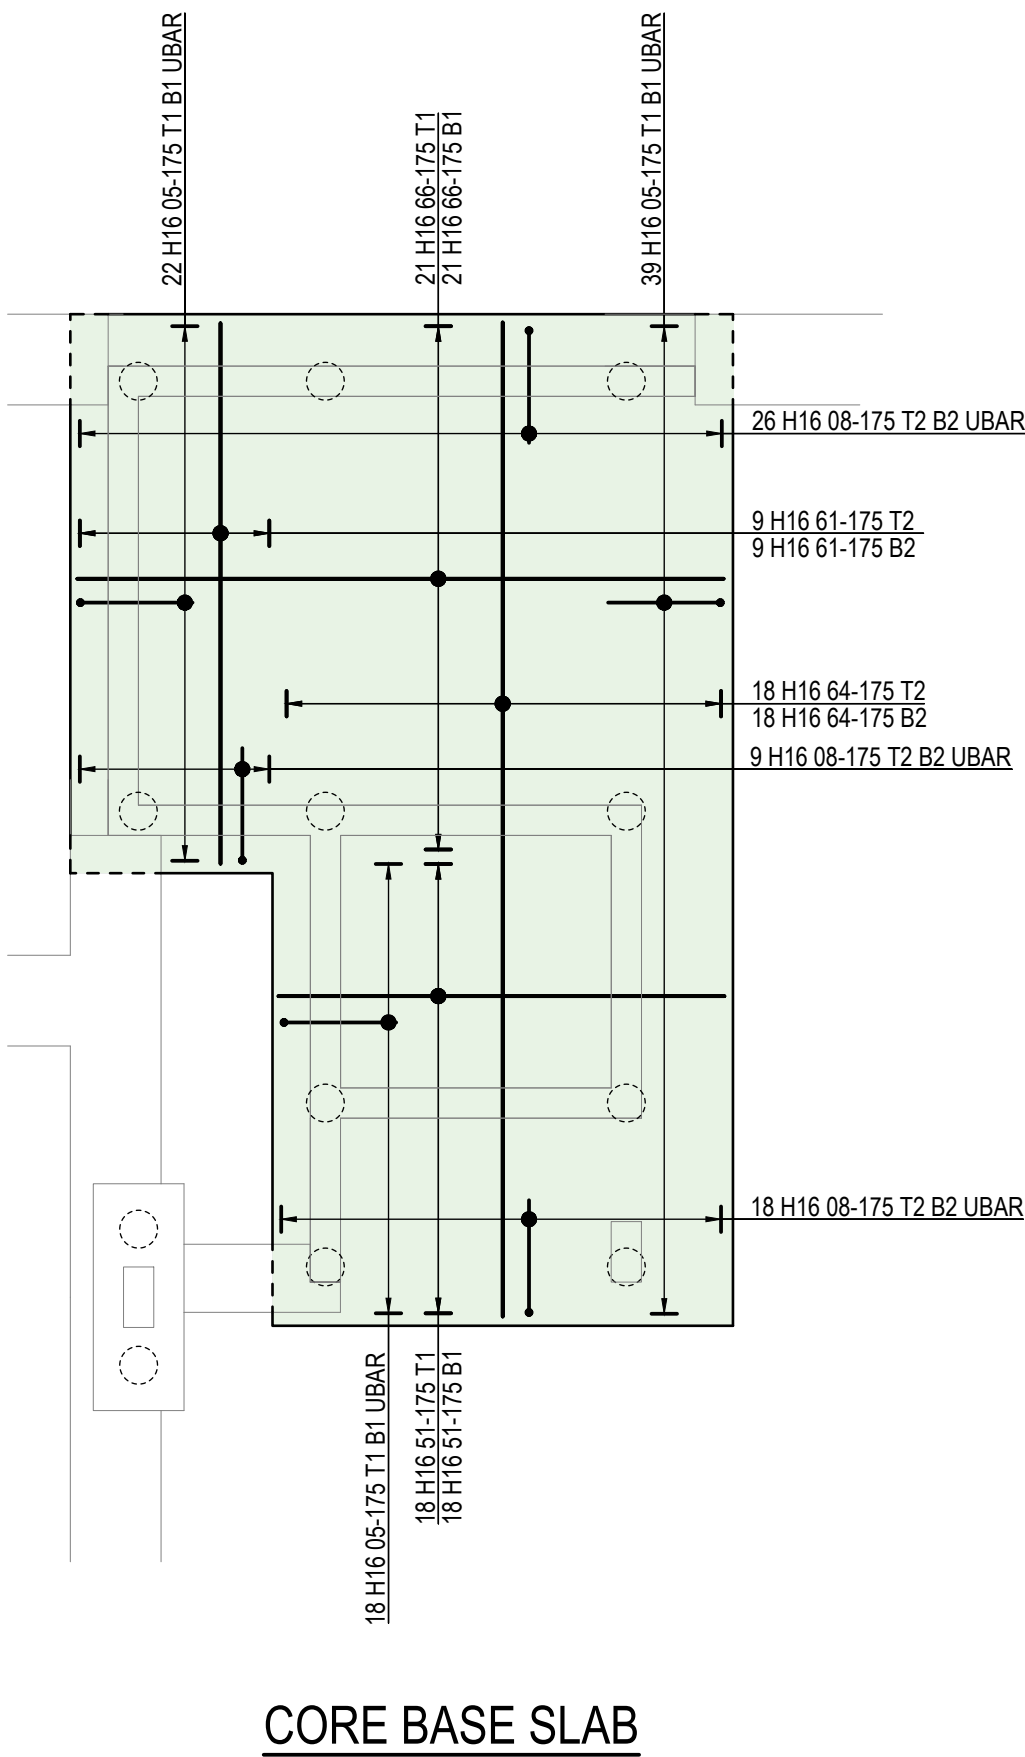


B	Reinforcement amended in line with latest Architectural layout Issued For Construction	DR	AF	19.04.24
A	First issue.	DR	AF	16/02/24
REV	DESCRIPTION	SIG	CHK	DATE

CALA HOMES (THAMES) LIMITED

BROOKLANDS COLLEGE
WEYBRIDGE

BLOCK A
GROUND BEAM RC LAYOUT

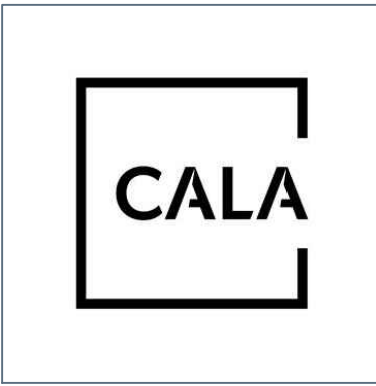

ECE PROJECT No SCALE AT A1 Drawing Status REV

48176 1:50 **CONSTRUCTION B**

Project
SA00394 - 5052 - S - BLOCKA- FND