

Date Requested: 04/07/2025  
Job Reference: 37876007  
Site Location: 554424 227878  
Requested by:  
Mrs TDS Midlands  
Your Scheme/Reference: Mill Road

Scale: 1:2050 (When plotted at A3)

View extent: 200m, 115m

**IMPORTANT NOTICES**

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with H5(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of an emergency call 0800 111 999**

<b>Dig Sites</b>	<b>Area:</b>	<b>Line:</b>
LP Mains	Valve	Diameter Change
MP Mains	Depth of cover	Material Change
IP Mains	Syphon	Out of Standard Service
LHP Mains		


Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following:

- Identification of shallow services
- Identification of dual services
- Recording of non-perpendicular services

A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.


**Cadent**  
Your Gas Network

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

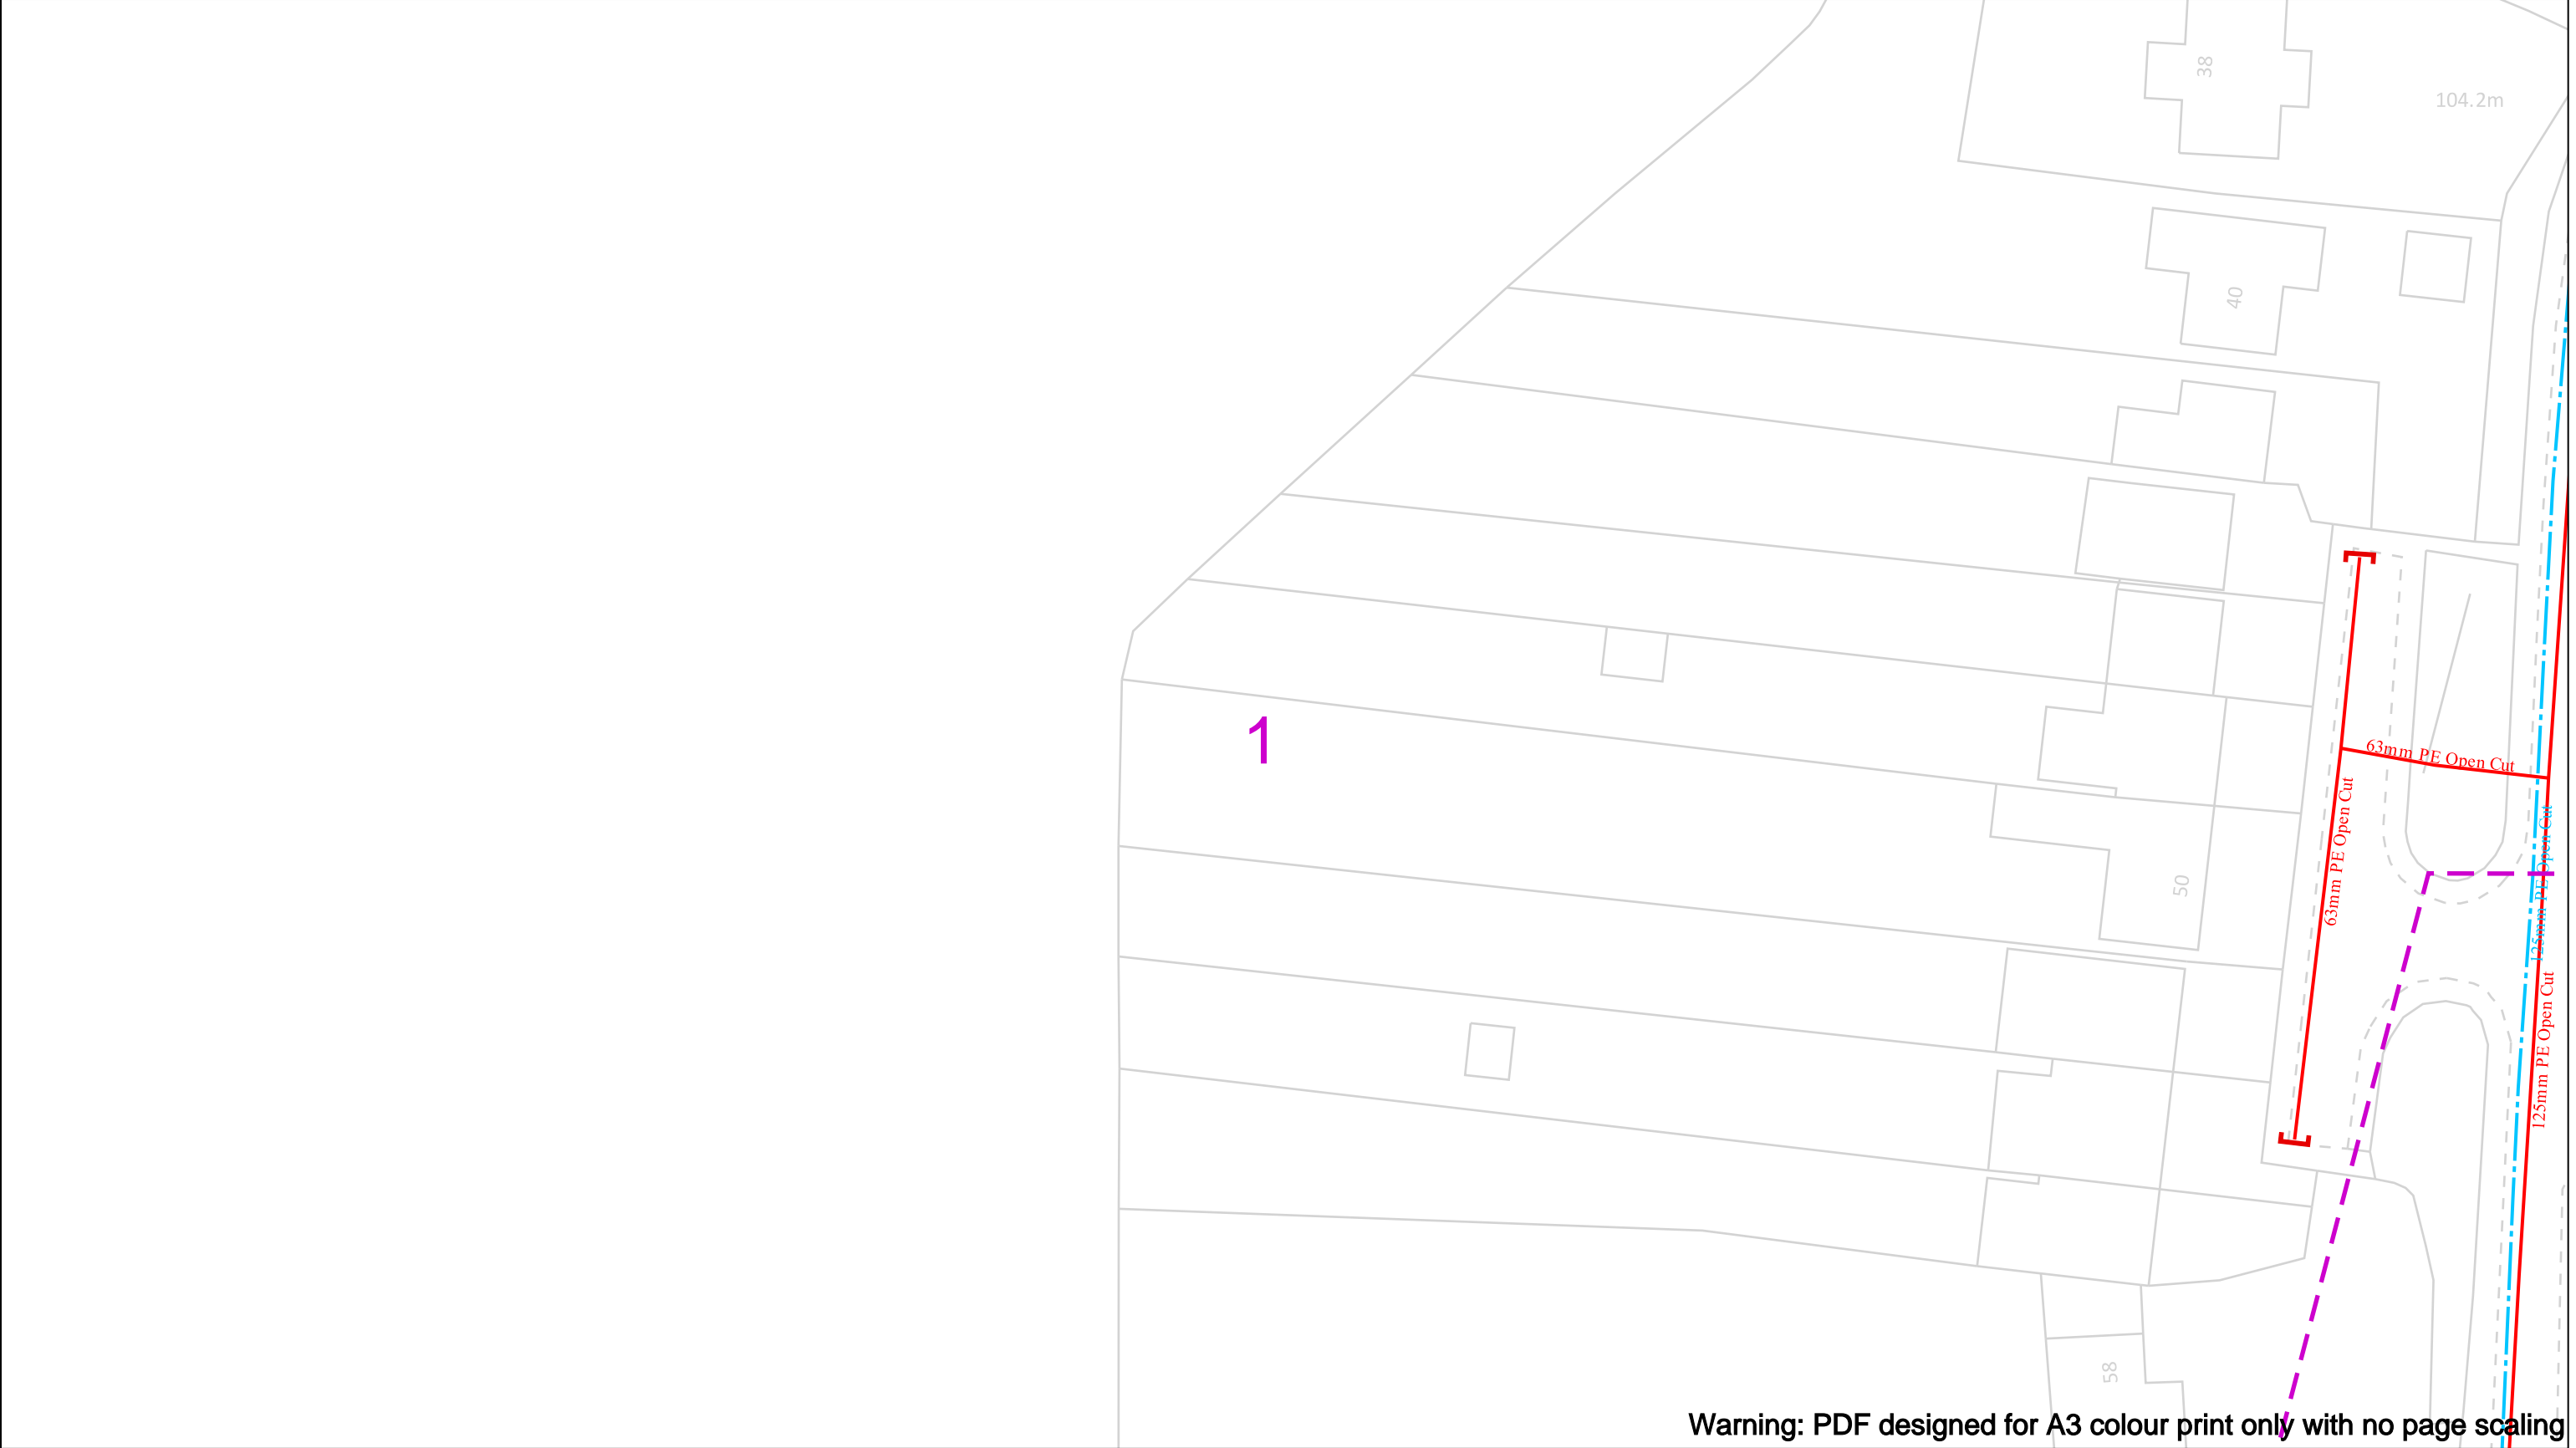


Warning: PDF designed for A3 colour print only with no page scaling

<div>Date Requested: 04/07/2025 Job Reference: 37876007 Site Location: 554424 227878 Requested by: Mrs TDS Midlands Your Scheme/Reference: Mill Road</div> <div>Scale: 1:500 (When plotted at A3)</div>		<div>View extent: 200m, 115m</div> <div>IMPORTANT NOTICES</div> <div>This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with H5(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</div>	<div>In case of an emergency call 0800 111 999</div> <div><div><div>Dig Sites</div><div><div><div>—</div>LP Mains</div><div><div>- - -</div>MP Mains</div><div><div>- - -</div>IP Mains</div><div><div>- - -</div>LHP Mains</div></div><div><div><div>⊗</div>Valve</div><div><div>∨</div>Depth of cover</div><div><div>○</div>Syphon</div></div><div><div><div>⚓</div>Diameter Change</div><div><div> </div>Material Change</div><div><div>!</div>Out of Standard Service</div></div></div></div>		<div>Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following:</div> <ul style="list-style-type: none"><li>• Identification of shallow services</li><li>• Identification of dual services</li><li>• Recording of non-perpendicular services</li></ul> <div>A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.</div>	<div><div>Cadent</div><div>Your Gas Network</div></div>
<div>Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886</div>						

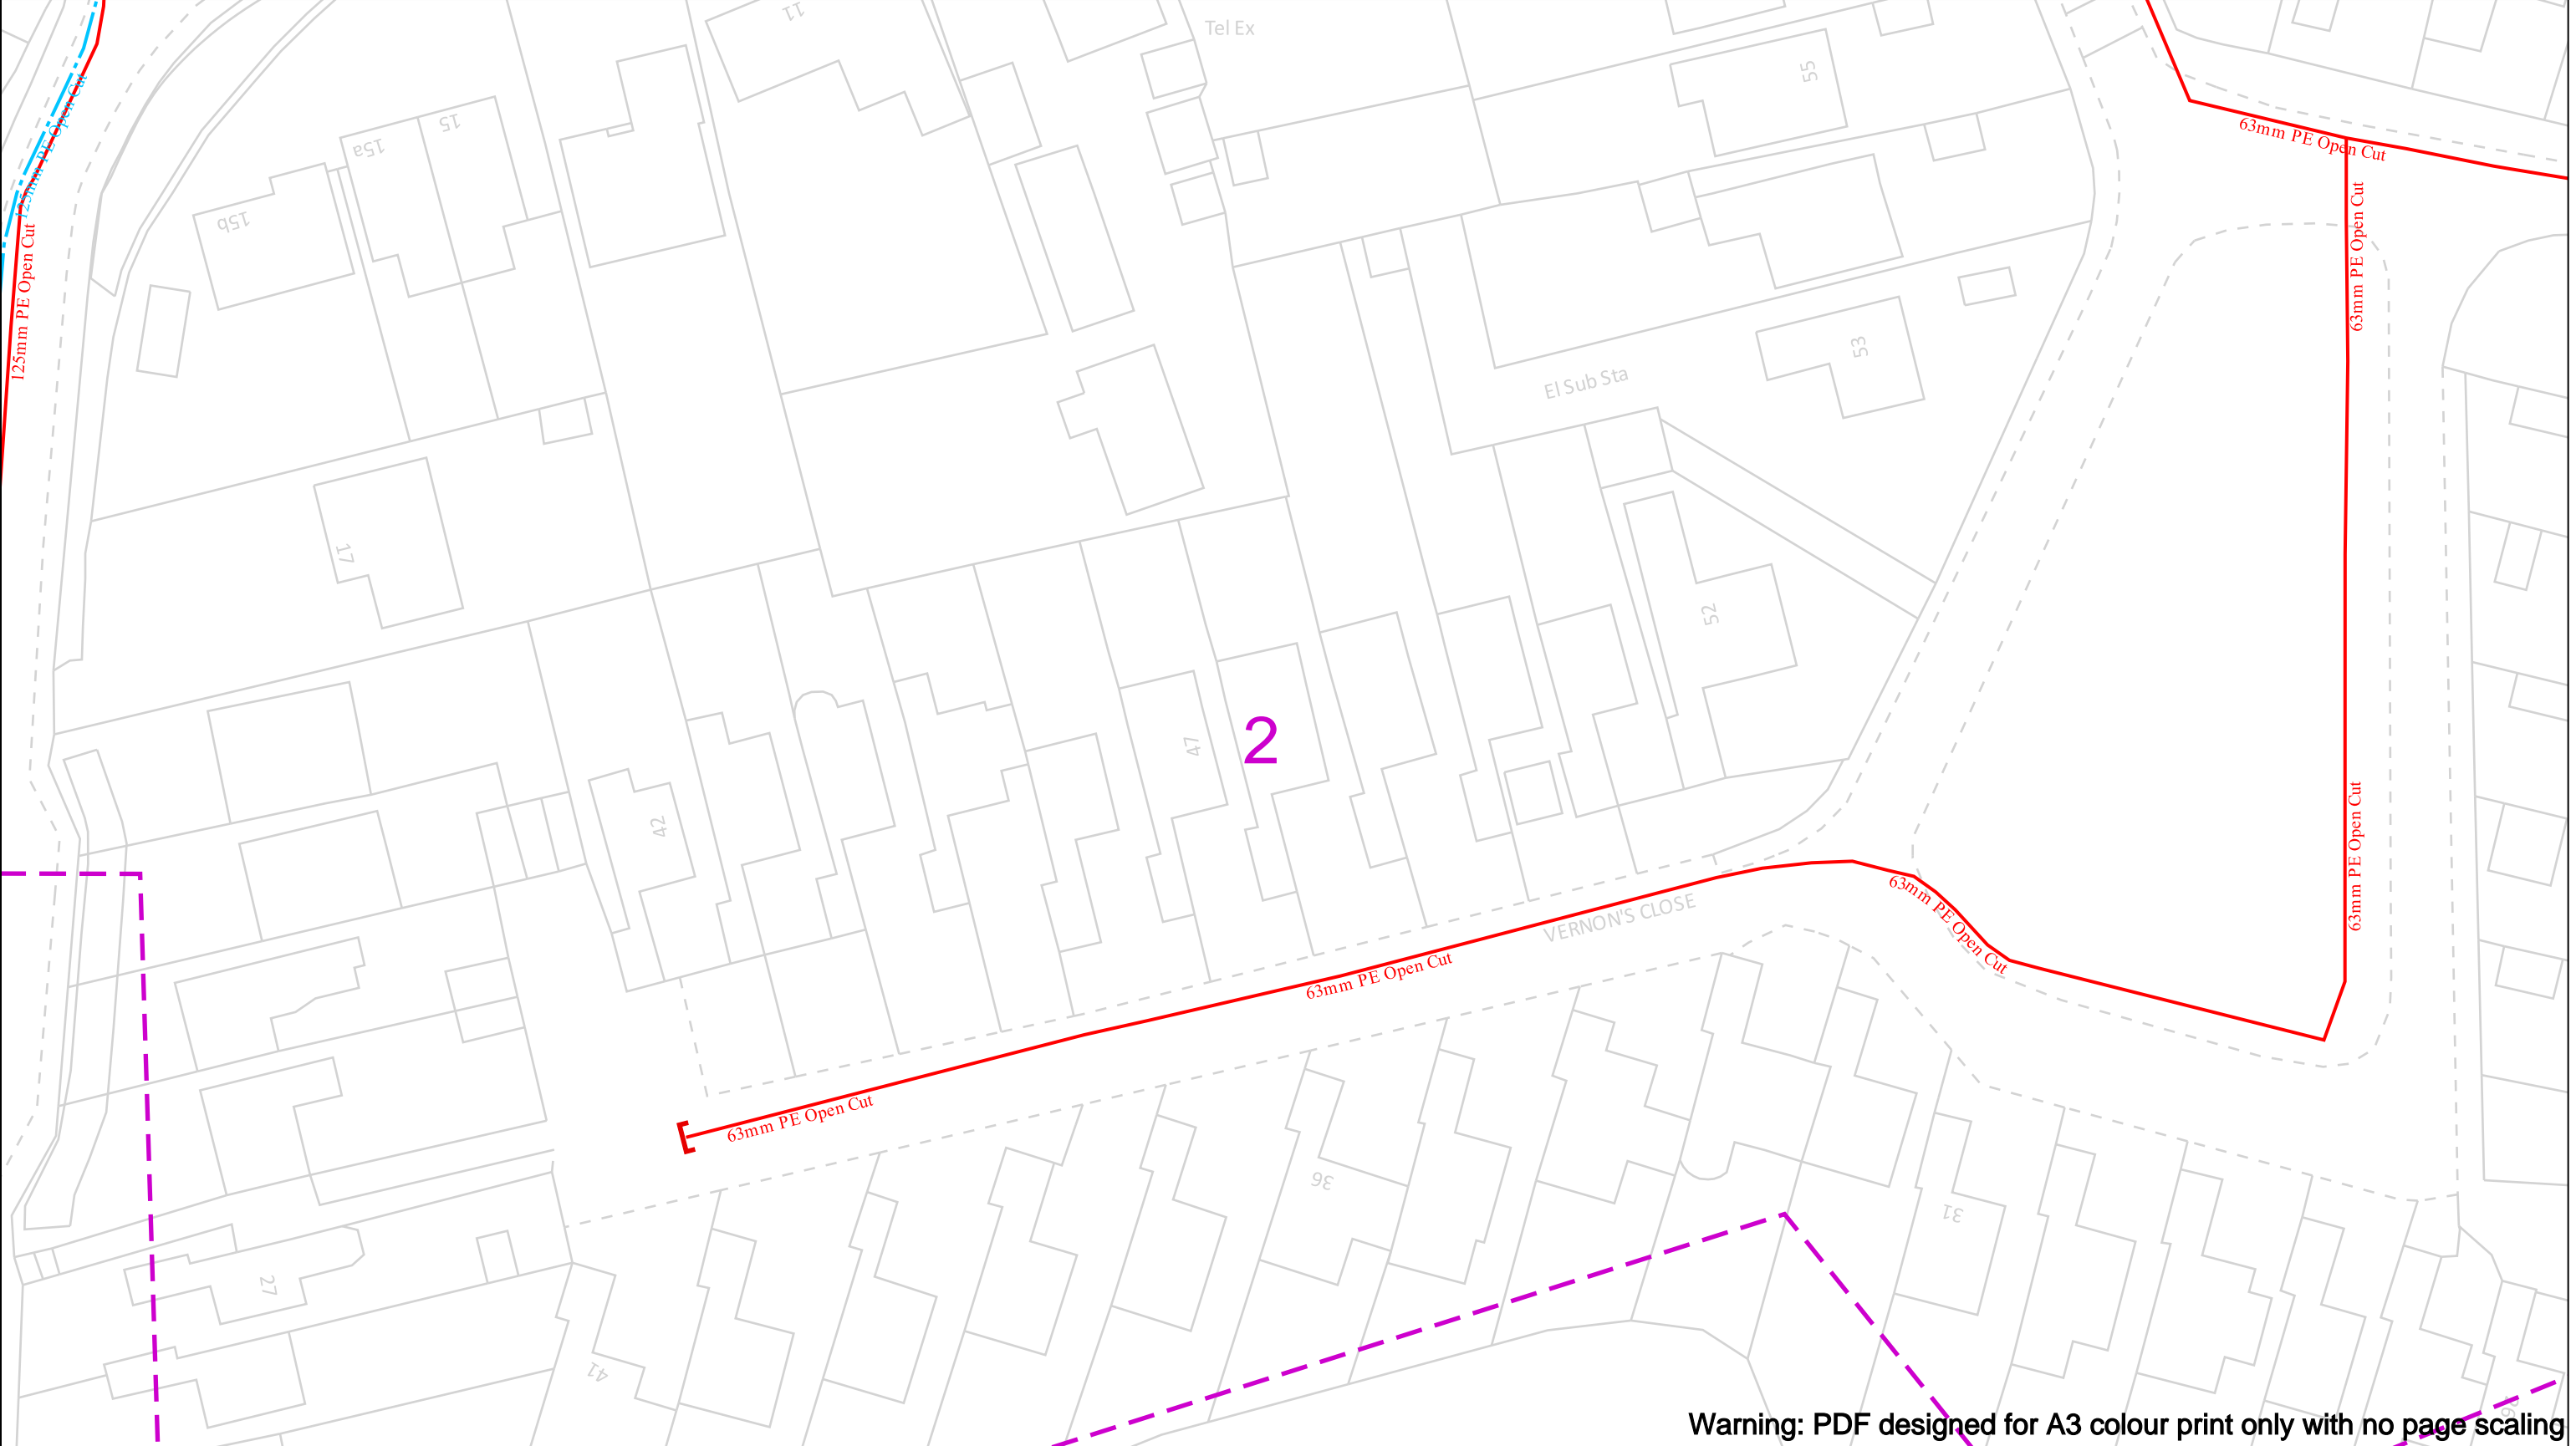





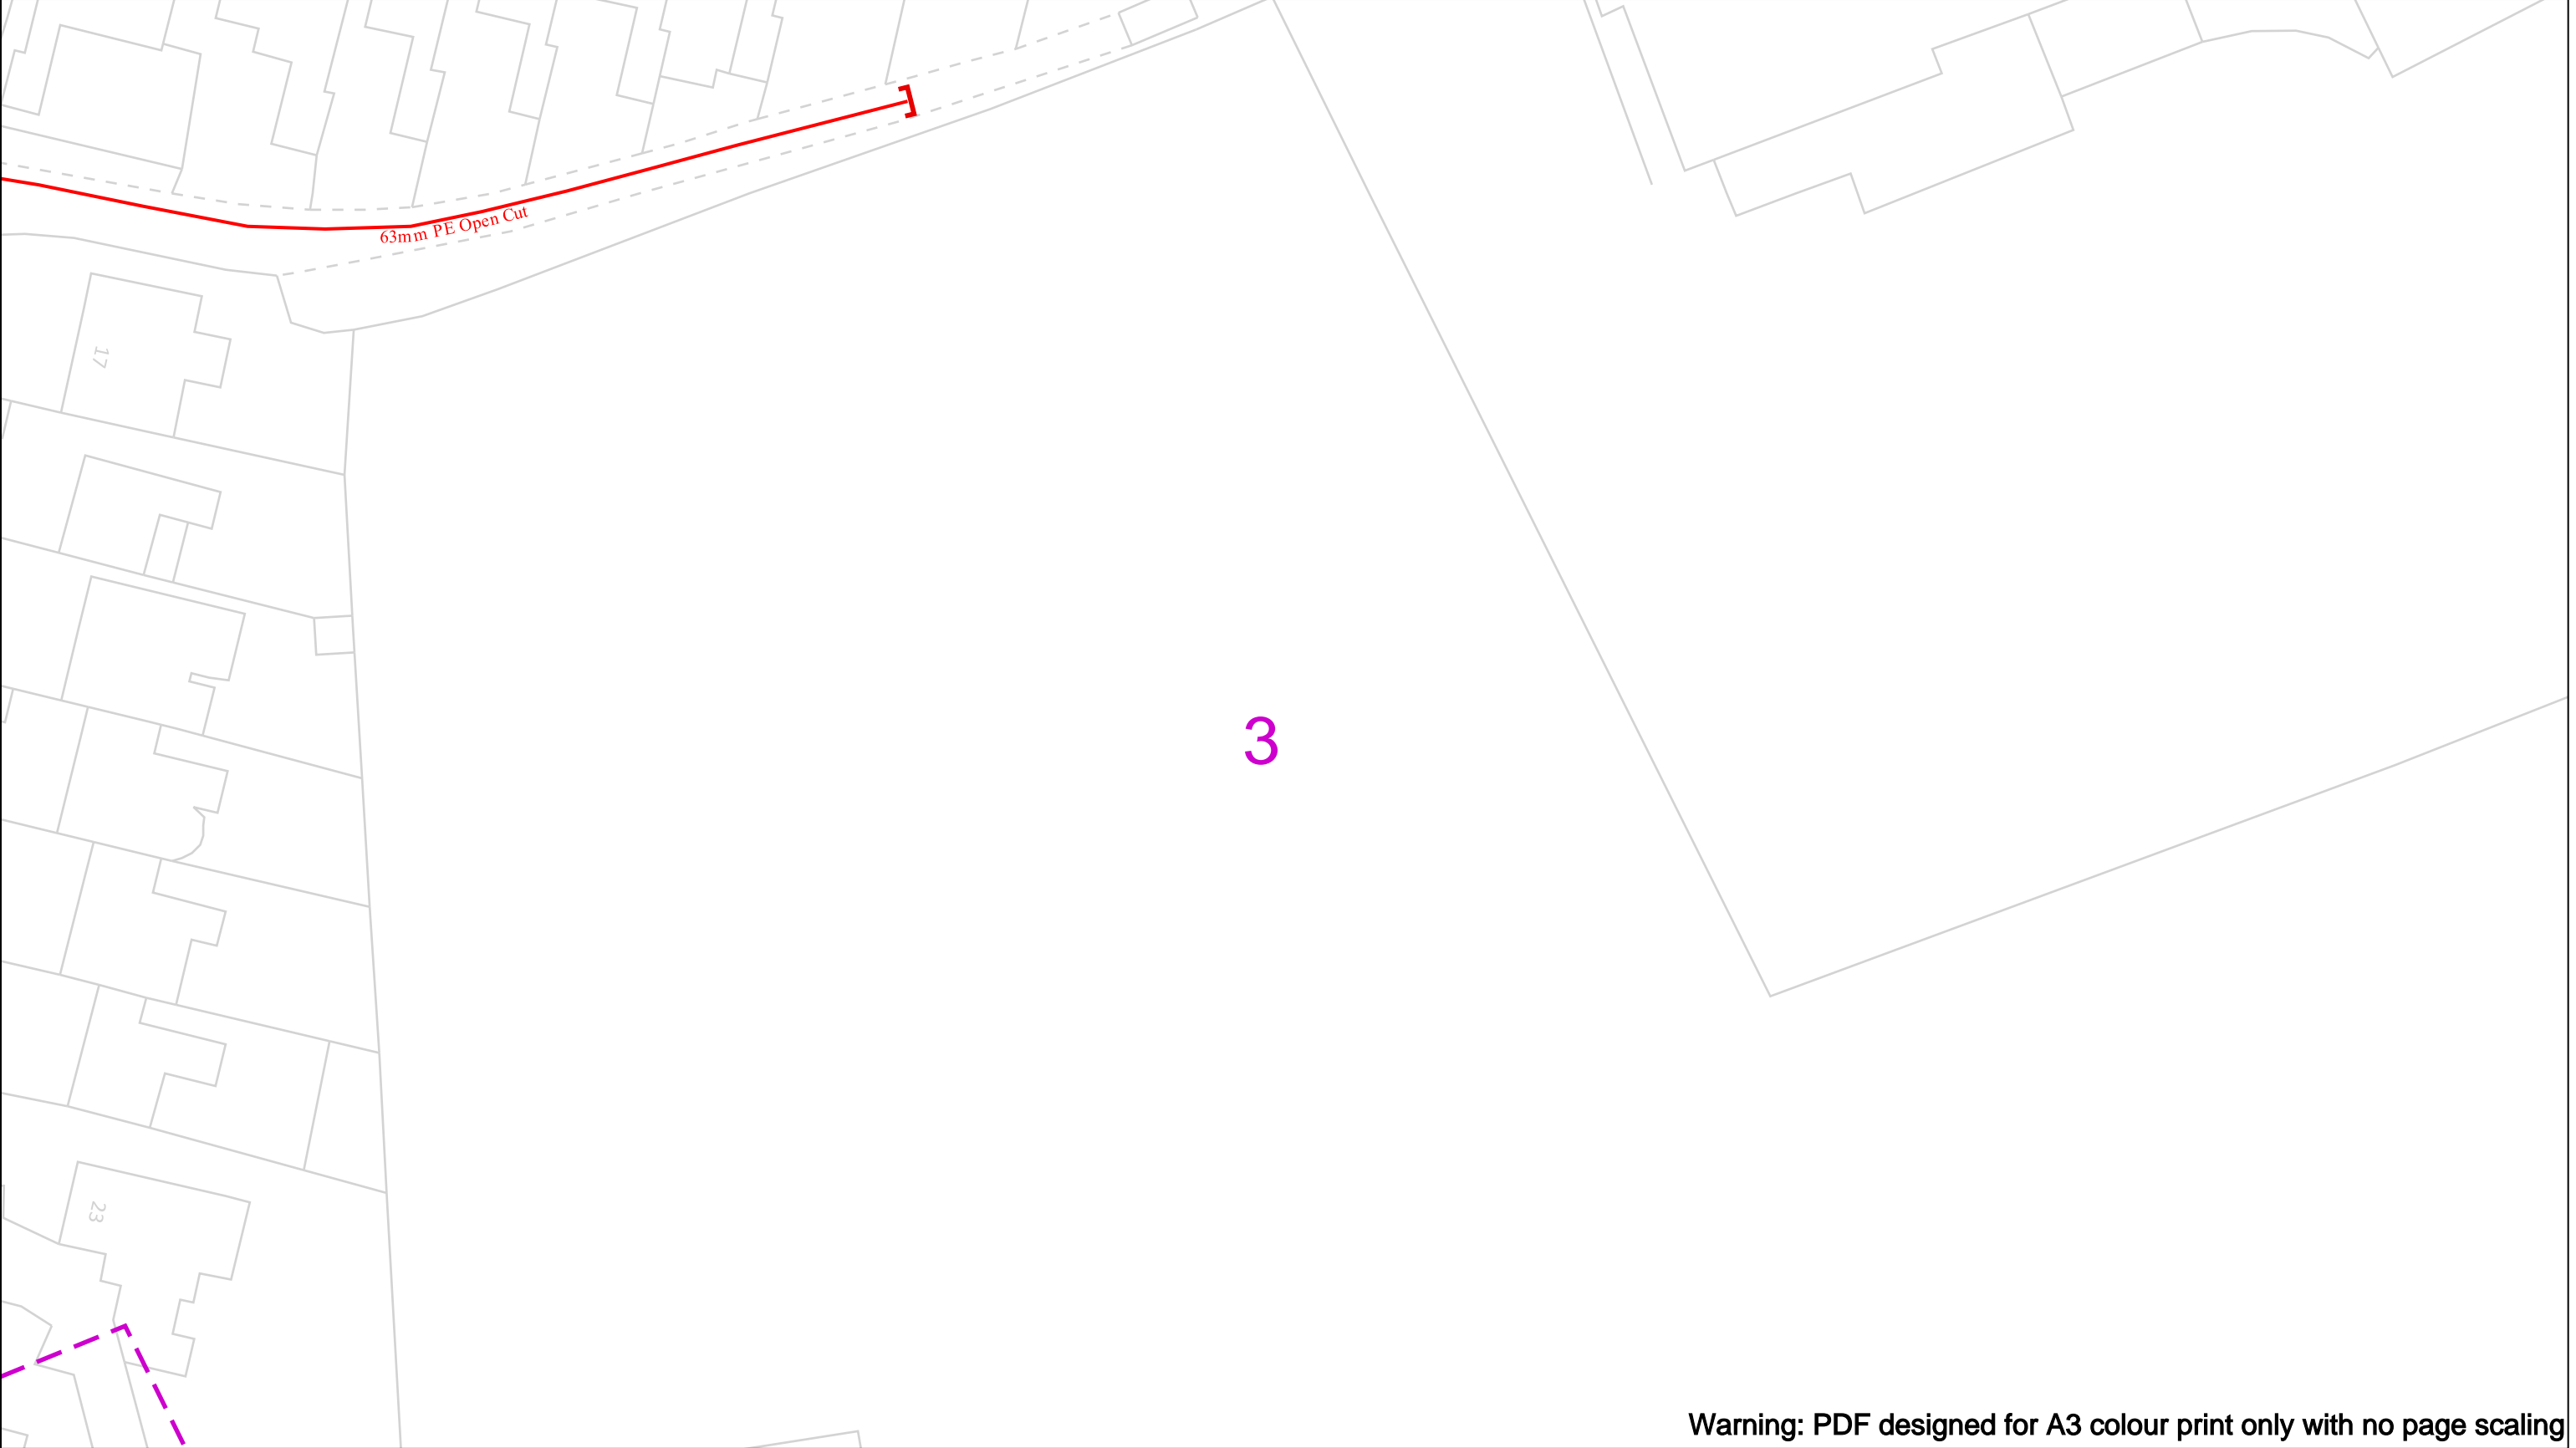

































Warning: PDF designed for A3 colour print only with no page scaling


<div>Date Requested: 04/07/2025 Job Reference: 37876007 Site Location: 554424 227878 Requested by: Mrs TDS Midlands Your Scheme/Reference: Mill Road</div> <div>Scale: 1:500 (When plotted at A3)</div>		<div>View extent: 200m, 115m</div> <div>IMPORTANT NOTICES</div> <div>This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with H5(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</div>	<div>In case of an emergency call 0800 111 999</div> <div><div><div>Dig Sites</div><div><div><div></div></div>LP Mains</div><div><div><div></div></div>MP Mains</div><div><div><div></div></div>IP Mains</div><div><div><div></div></div>LHP Mains</div></div><div><div>Area:</div><div><div><div></div></div>Valve</div><div><div><div></div></div>Depth of cover</div><div><div><div></div></div>Syphon</div></div><div><div>Line:</div><div><div><div></div></div>Diameter Change</div><div><div><div></div></div>Material Change</div><div><div><div></div></div>Out of Standard Service</div></div></div> <div><div>50m</div><div>Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following:<ul style="list-style-type: none"><li>• Identification of shallow services</li><li>• Identification of dual services</li><li>• Recording of non-perpendicular services</li></ul>A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.</div></div>		<div><div>Cadent</div><div>Your Gas Network</div></div>
<div>Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886</div>					



Warning: PDF designed for A3 colour print only with no page scaling

	View extent: 200m, 115m	<b>In case of an emergency call 0800 111 999</b>		 <b>Your Gas Network</b>															
Date Requested: 04/07/2025 Job Reference: 37876007 Site Location: 554424 227878 Requested by: Mrs TDS Midlands Your Scheme/Reference: Mill Road	<b>IMPORTANT NOTICES</b> <p>This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with H5(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</p>	 <table><tr><td><b>Dig Sites</b></td><td><b>Area:</b> </td><td><b>Line:</b> </td></tr><tr><td> LP Mains</td><td> Valve</td><td> Diameter Change</td></tr><tr><td> MP Mains</td><td> Depth of cover</td><td> Material Change</td></tr><tr><td> IP Mains</td><td> Syphon</td><td> Out of Standard Service</td></tr><tr><td> LHP Mains</td><td></td><td></td></tr></table>			<b>Dig Sites</b>	<b>Area:</b> 	<b>Line:</b> 	 LP Mains	 Valve	 Diameter Change	 MP Mains	 Depth of cover	 Material Change	 IP Mains	 Syphon	 Out of Standard Service	 LHP Mains		
<b>Dig Sites</b>	<b>Area:</b> 	<b>Line:</b> 																	
 LP Mains	 Valve	 Diameter Change																	
 MP Mains	 Depth of cover	 Material Change																	
 IP Mains	 Syphon	 Out of Standard Service																	
 LHP Mains																			
Scale: 1:500 (When plotted at A3)		<p>Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following:</p> <ul style="list-style-type: none"><li>• Identification of shallow services</li><li>• Identification of dual services</li><li>• Recording of non-perpendicular services</li></ul> <p>A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.</p>																	

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

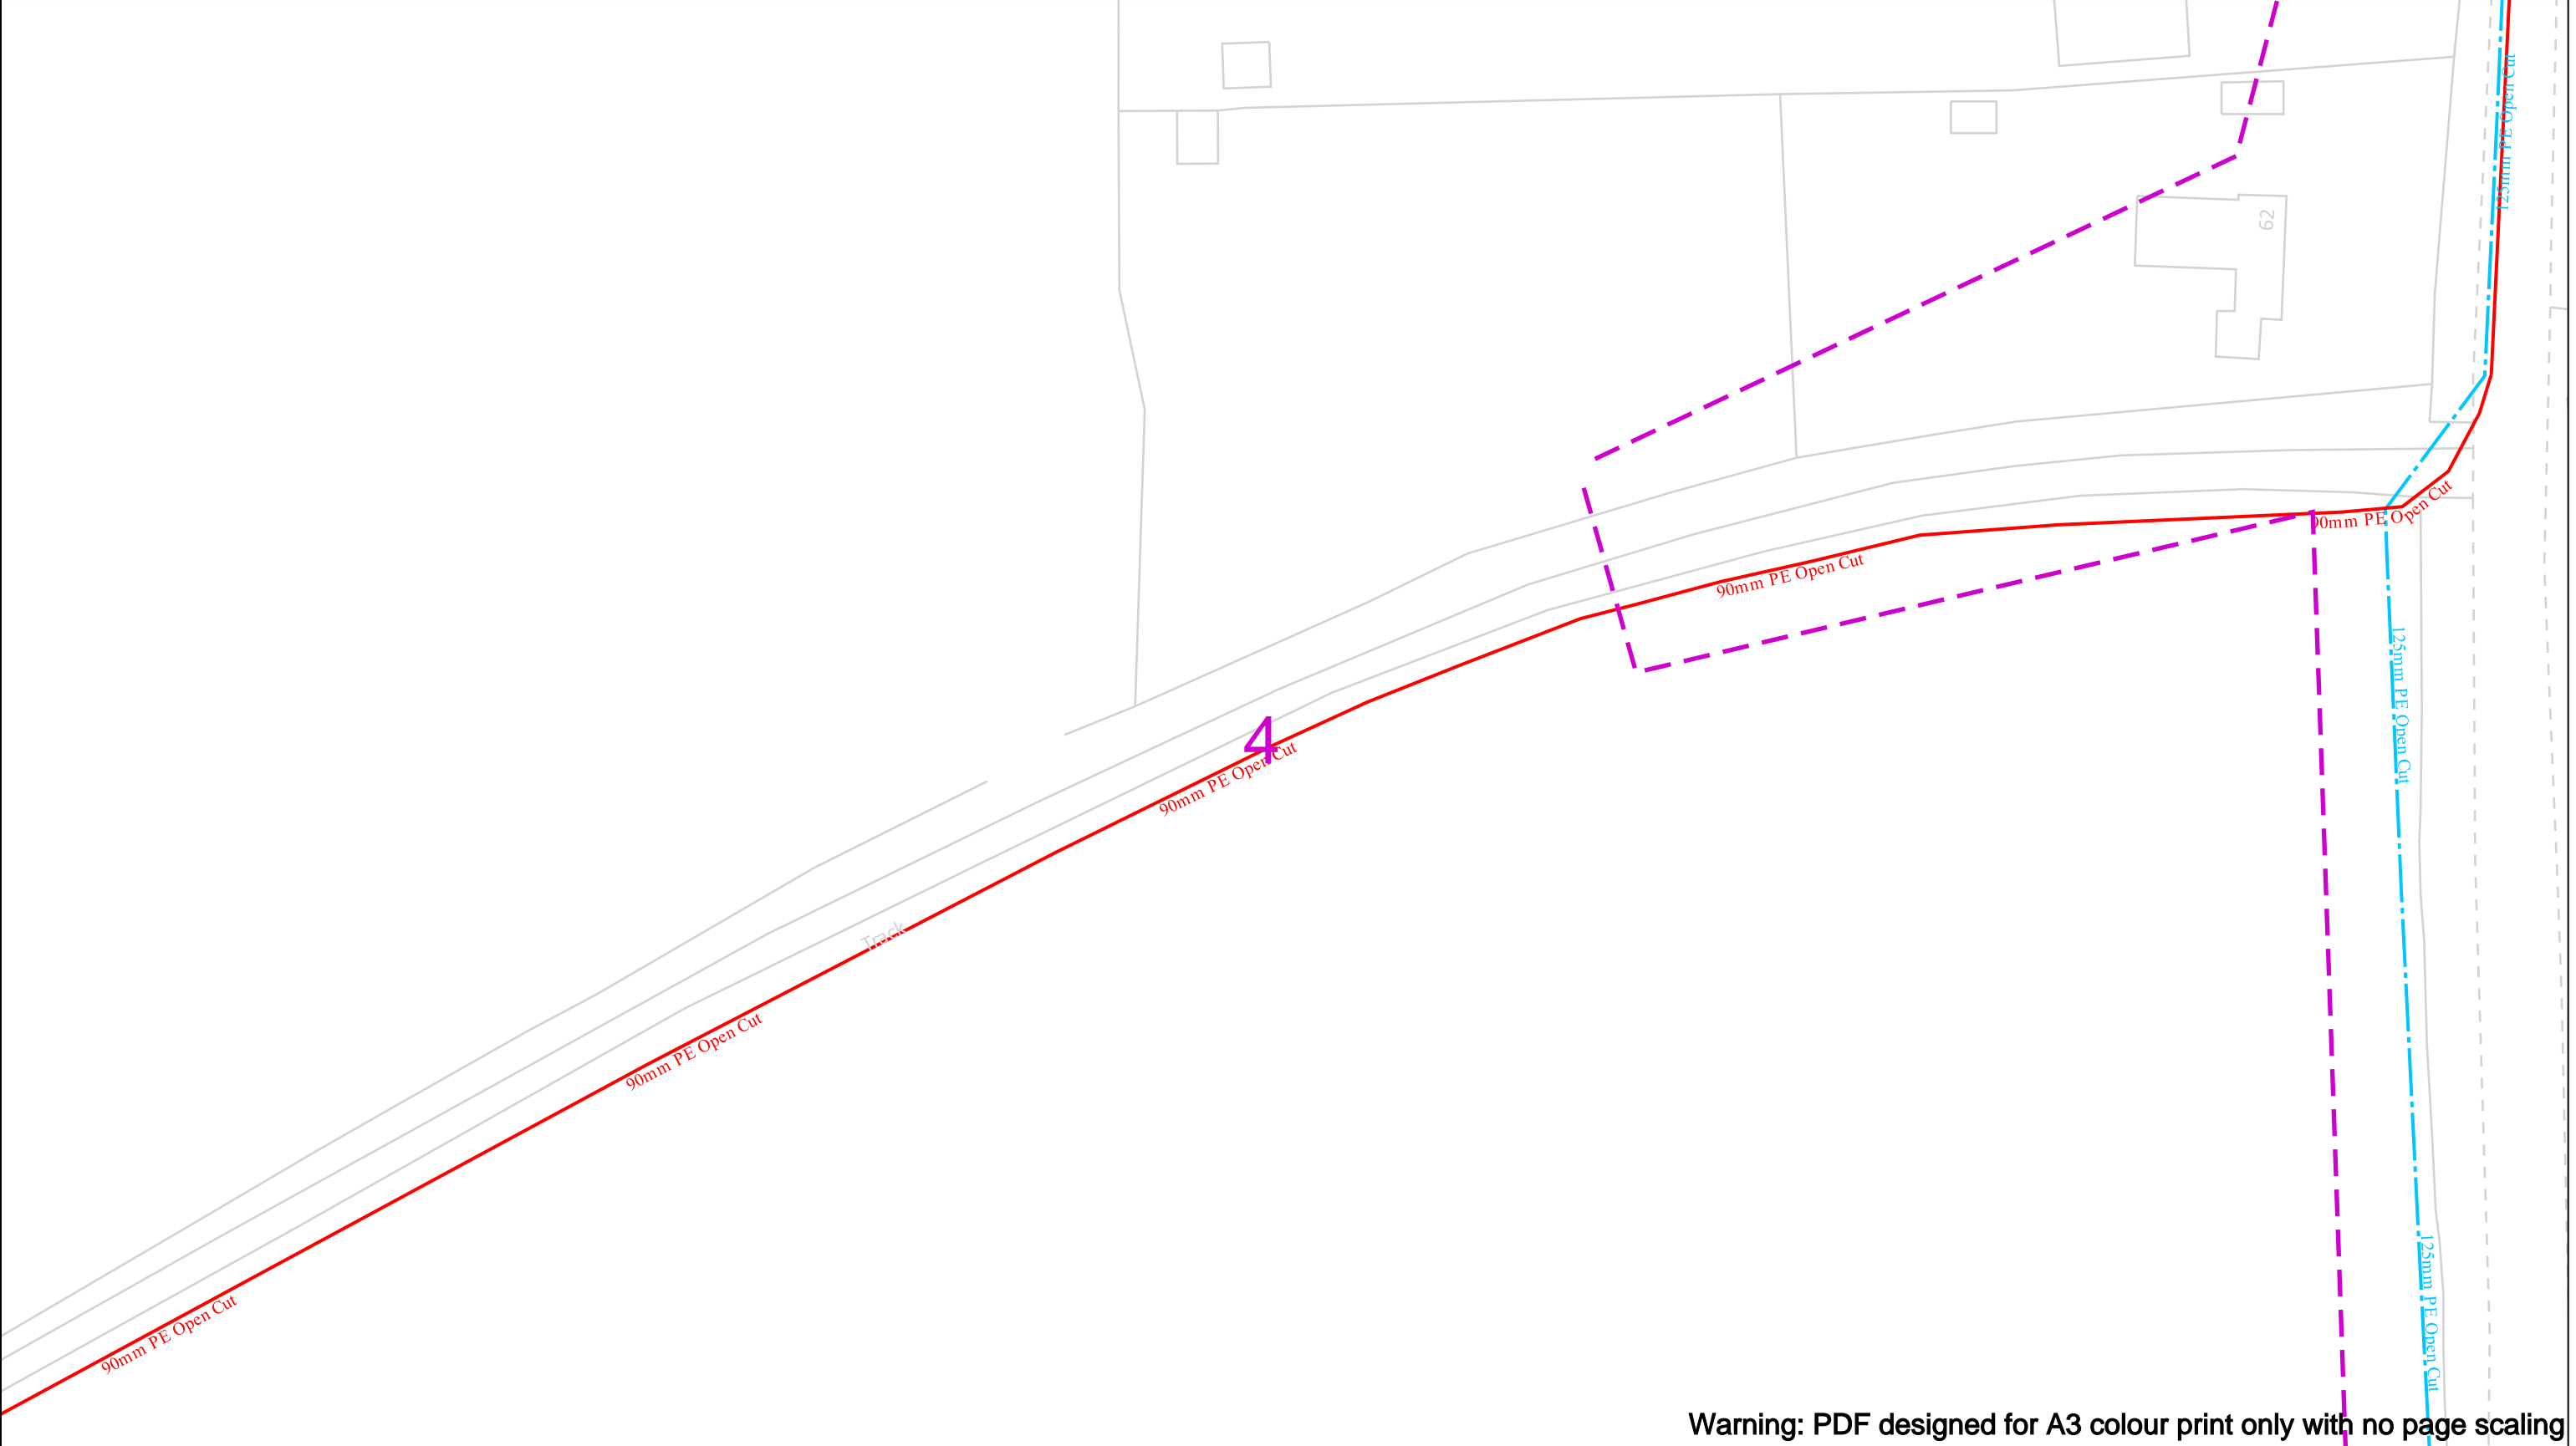

Warning: PDF designed for A3 colour print only with no page scaling

Date Requested: 04/07/2025  
Job Reference: 37876007  
Site Location: 554424 227878  
Requested by:  
Mrs TDS Midlands  
Your Scheme/Reference: Mill Road

Scale: 1:500 (When plotted at A3)

View extent: 200m, 115m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with H5(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

**In case of an emergency call 0800 111 999**

50m

<b>Dig Sites</b>	Area:	Line:
LP Mains	Valve	Diameter Change
MP Mains	Depth of cover	Material Change
IP Mains	Syphon	Out of Standard Service
LHP Mains		


Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following:

- Identification of shallow services
- Identification of dual services
- Recording of non-perpendicular services







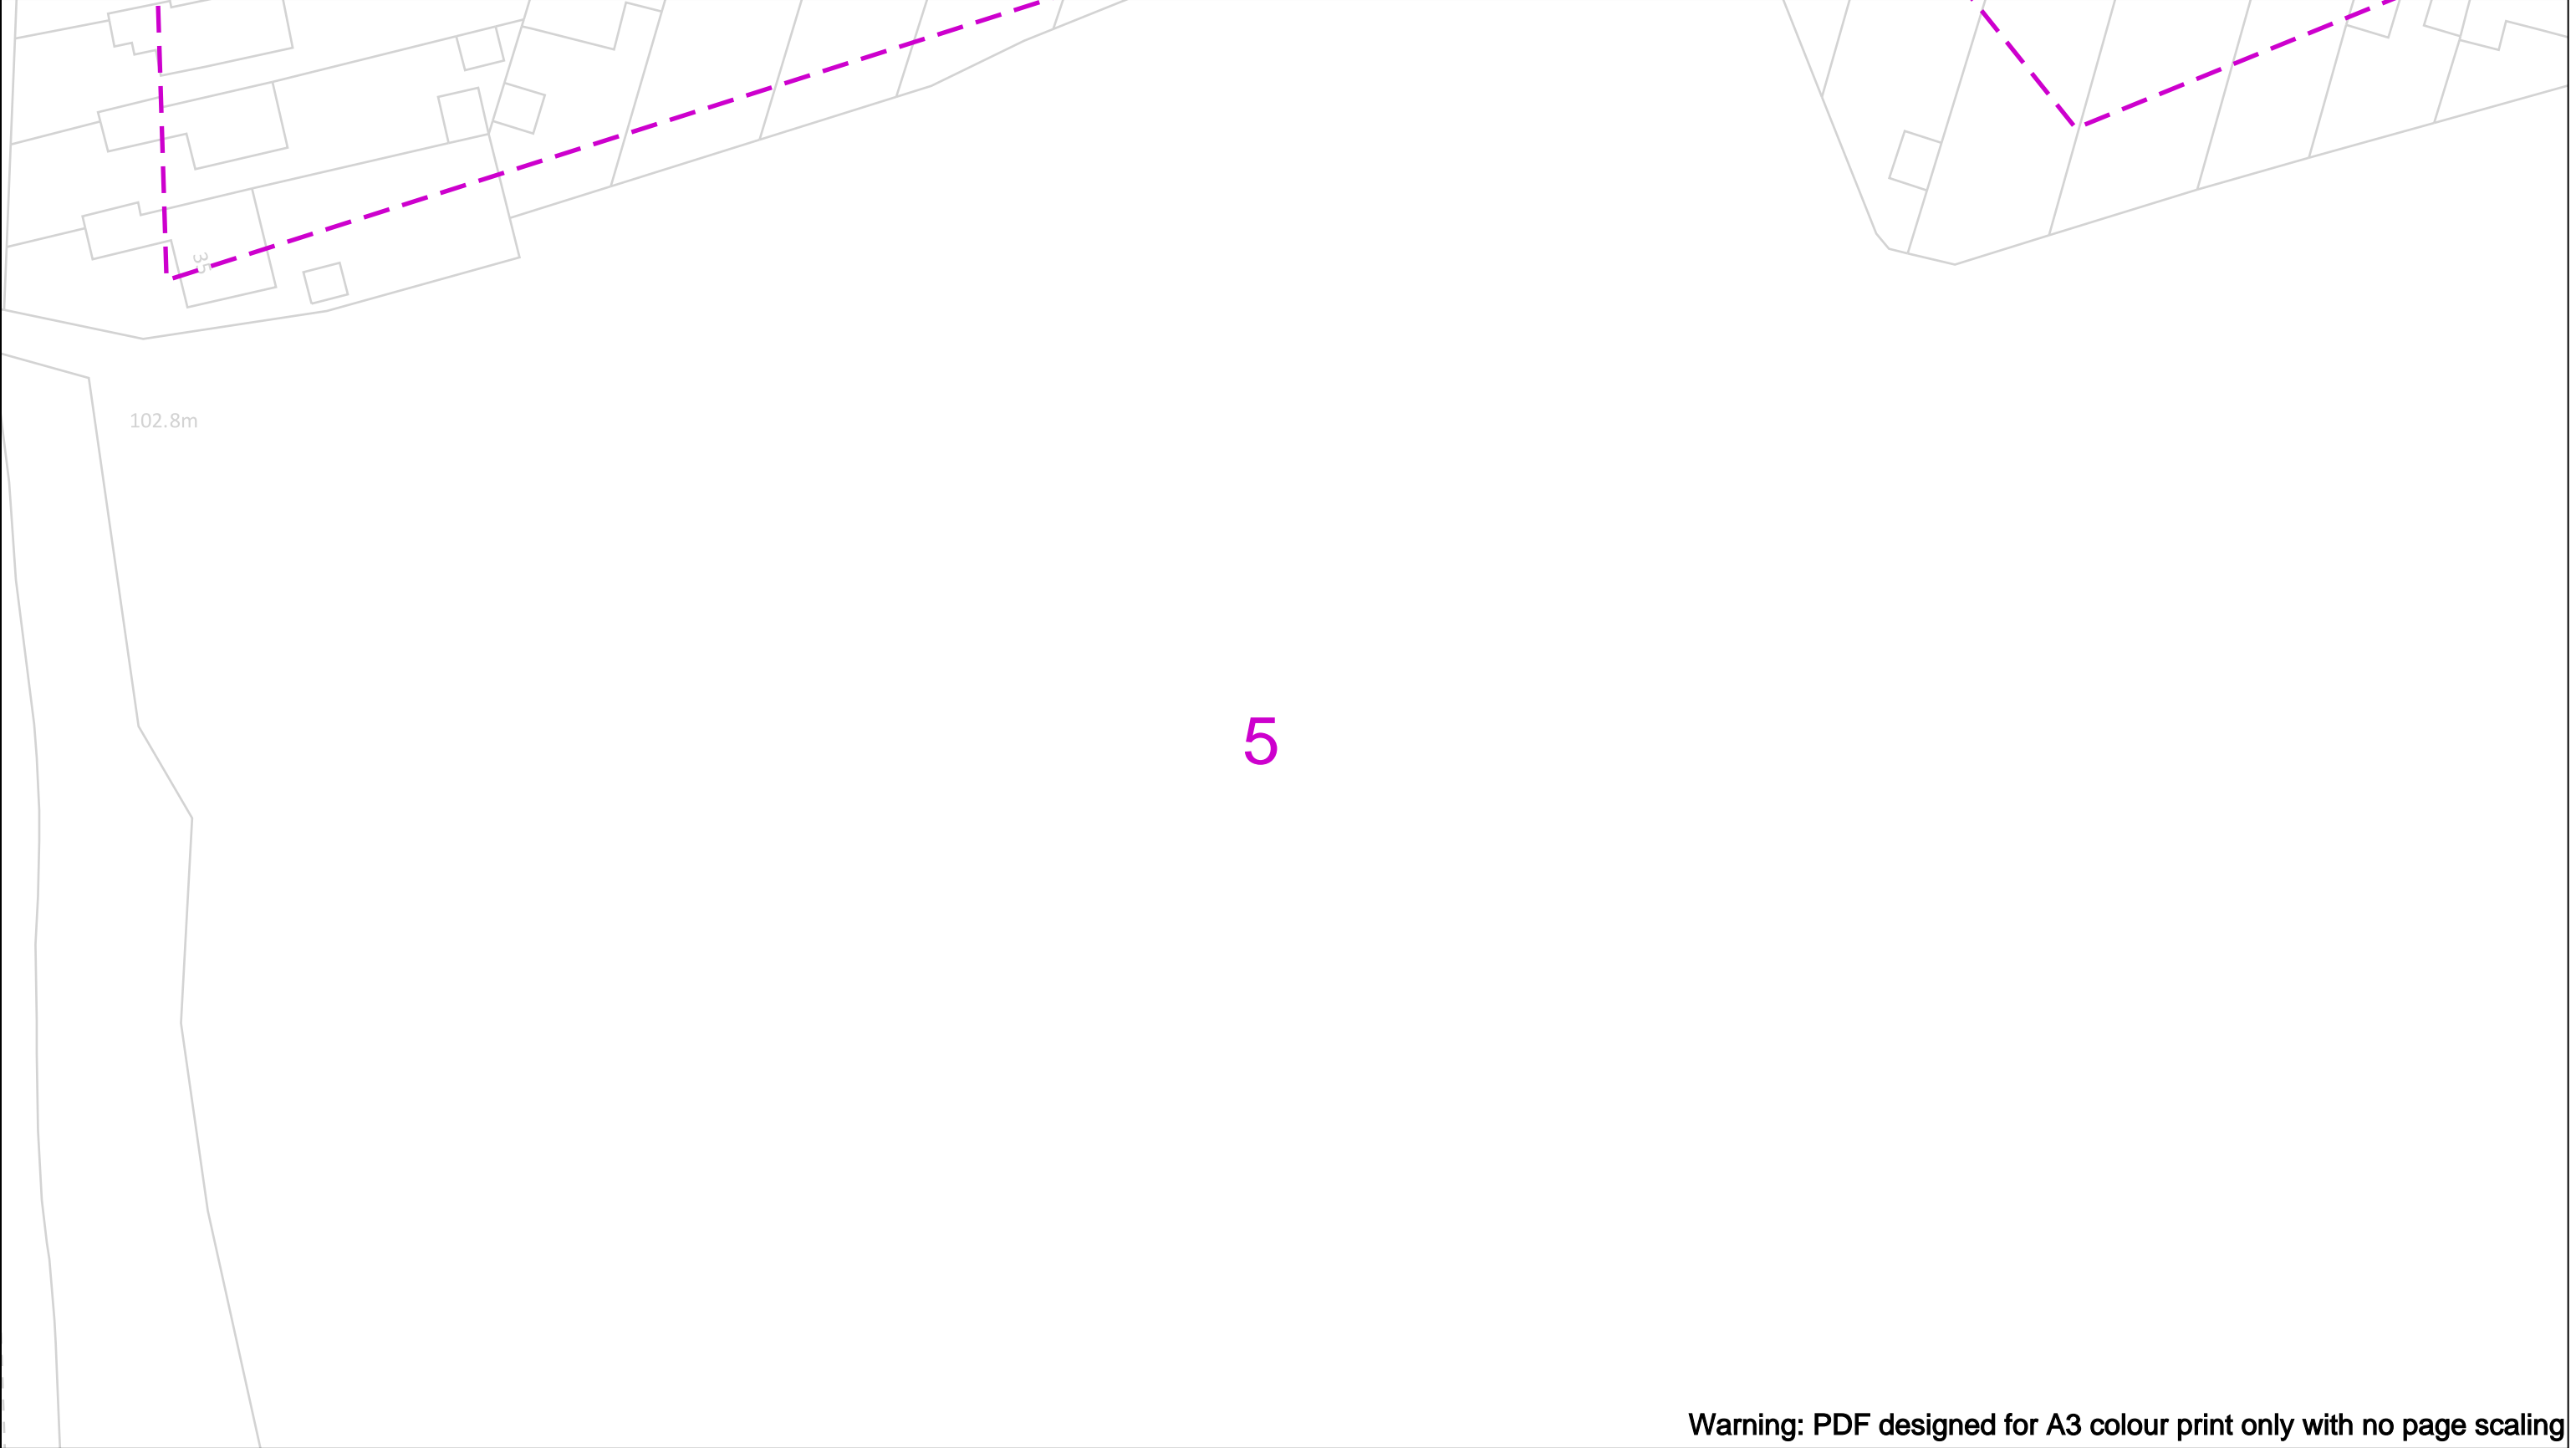

























A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.

**Cadent**


Your Gas Network



Warning: PDF designed for A3 colour print only with no page scaling


	View extent: 200m, 115m	<b>In case of an emergency call 0800 111 999</b>		 <b>Your Gas Network</b>																									
Date Requested: 04/07/2025 Job Reference: 37876007 Site Location: 554424 227878 Requested by: Mrs TDS Midlands Your Scheme/Reference: Mill Road	IMPORTANT NOTICES  This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.	 <b>Dig Sites</b> <table><tr><td></td><td>LP Mains</td><td></td><td>Valve</td><td></td><td>Diameter Change</td></tr><tr><td></td><td>MP Mains</td><td></td><td>Depth of cover</td><td></td><td>Material Change</td></tr><tr><td></td><td>IP Mains</td><td></td><td>Syphon</td><td></td><td>Out of Standard Service</td></tr><tr><td></td><td>LHP Mains</td><td></td><td></td><td></td><td></td></tr></table>				LP Mains		Valve		Diameter Change		MP Mains		Depth of cover		Material Change		IP Mains		Syphon		Out of Standard Service		LHP Mains					<p>Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information.</p> <p>Out-of-standard service symbology may be used to indicate one or more of the following:</p> <ul style="list-style-type: none"><li>• Identification of shallow services</li><li>• Identification of dual services</li><li>• Recording of non-perpendicular services</li></ul> <p>A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.</p>
	LP Mains		Valve			Diameter Change																							
	MP Mains		Depth of cover		Material Change																								
	IP Mains		Syphon		Out of Standard Service																								
	LHP Mains																												
Scale: 1:500 (When plotted at A3)																													

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

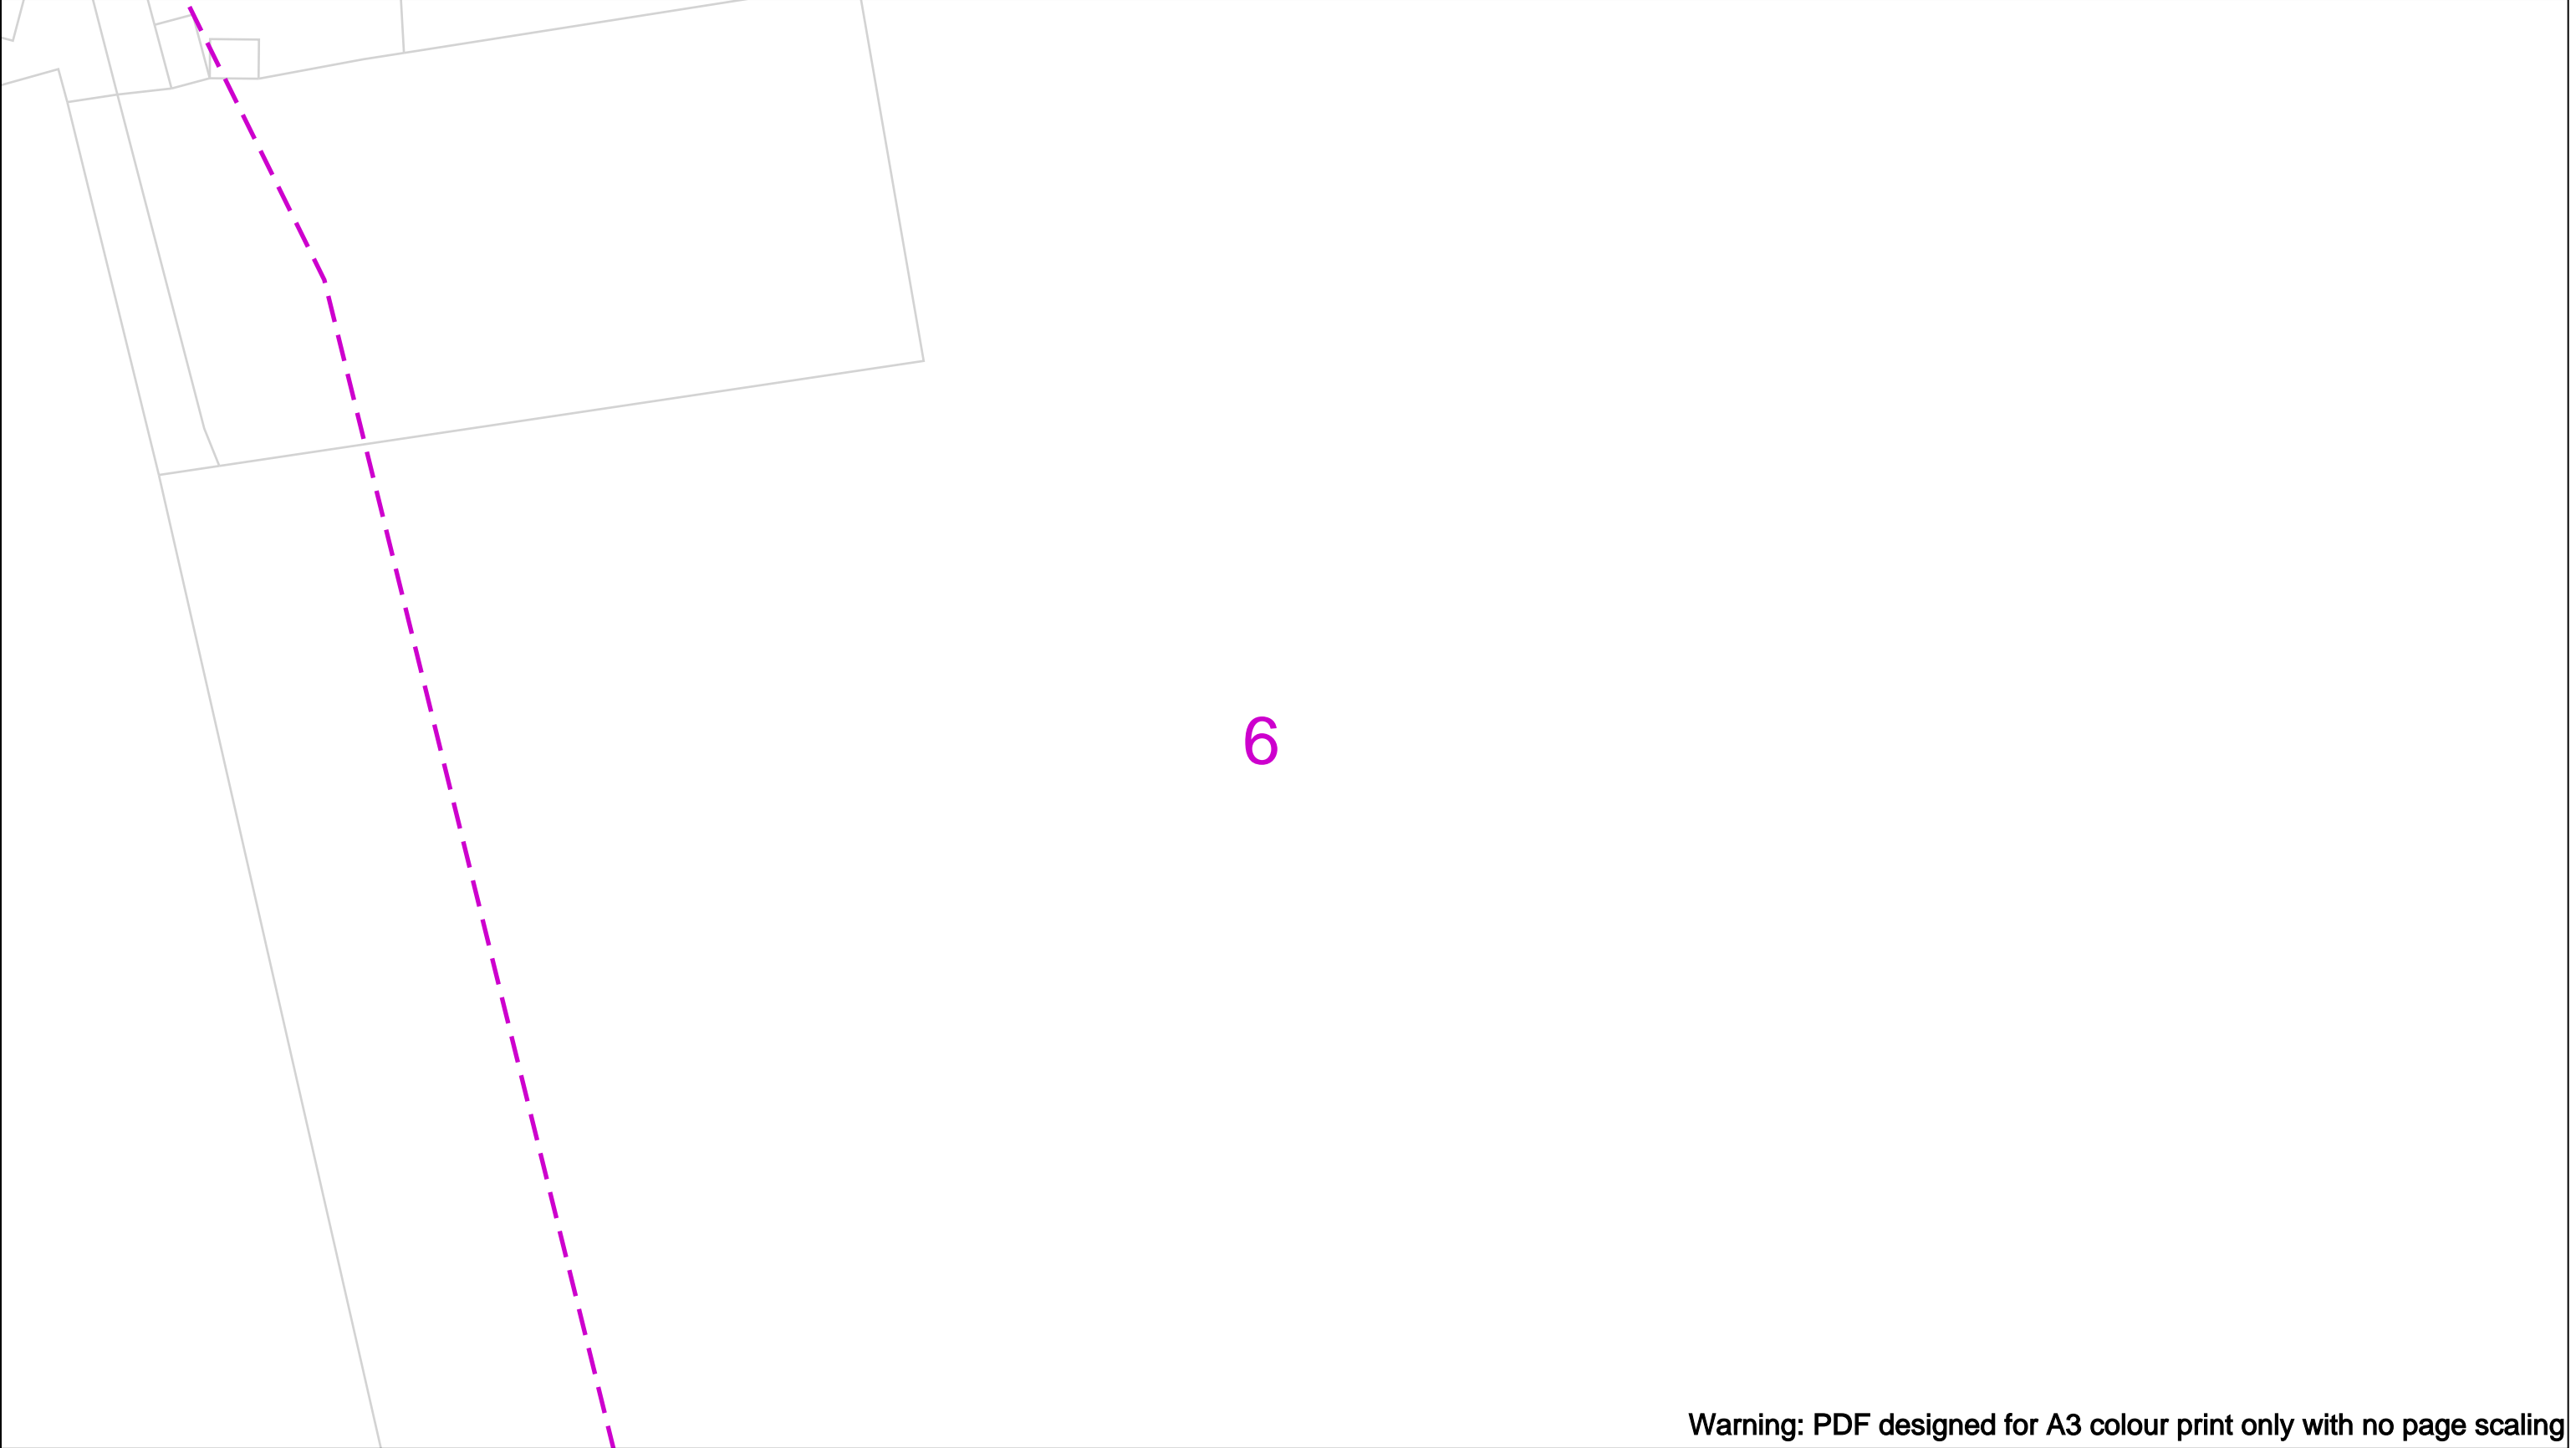





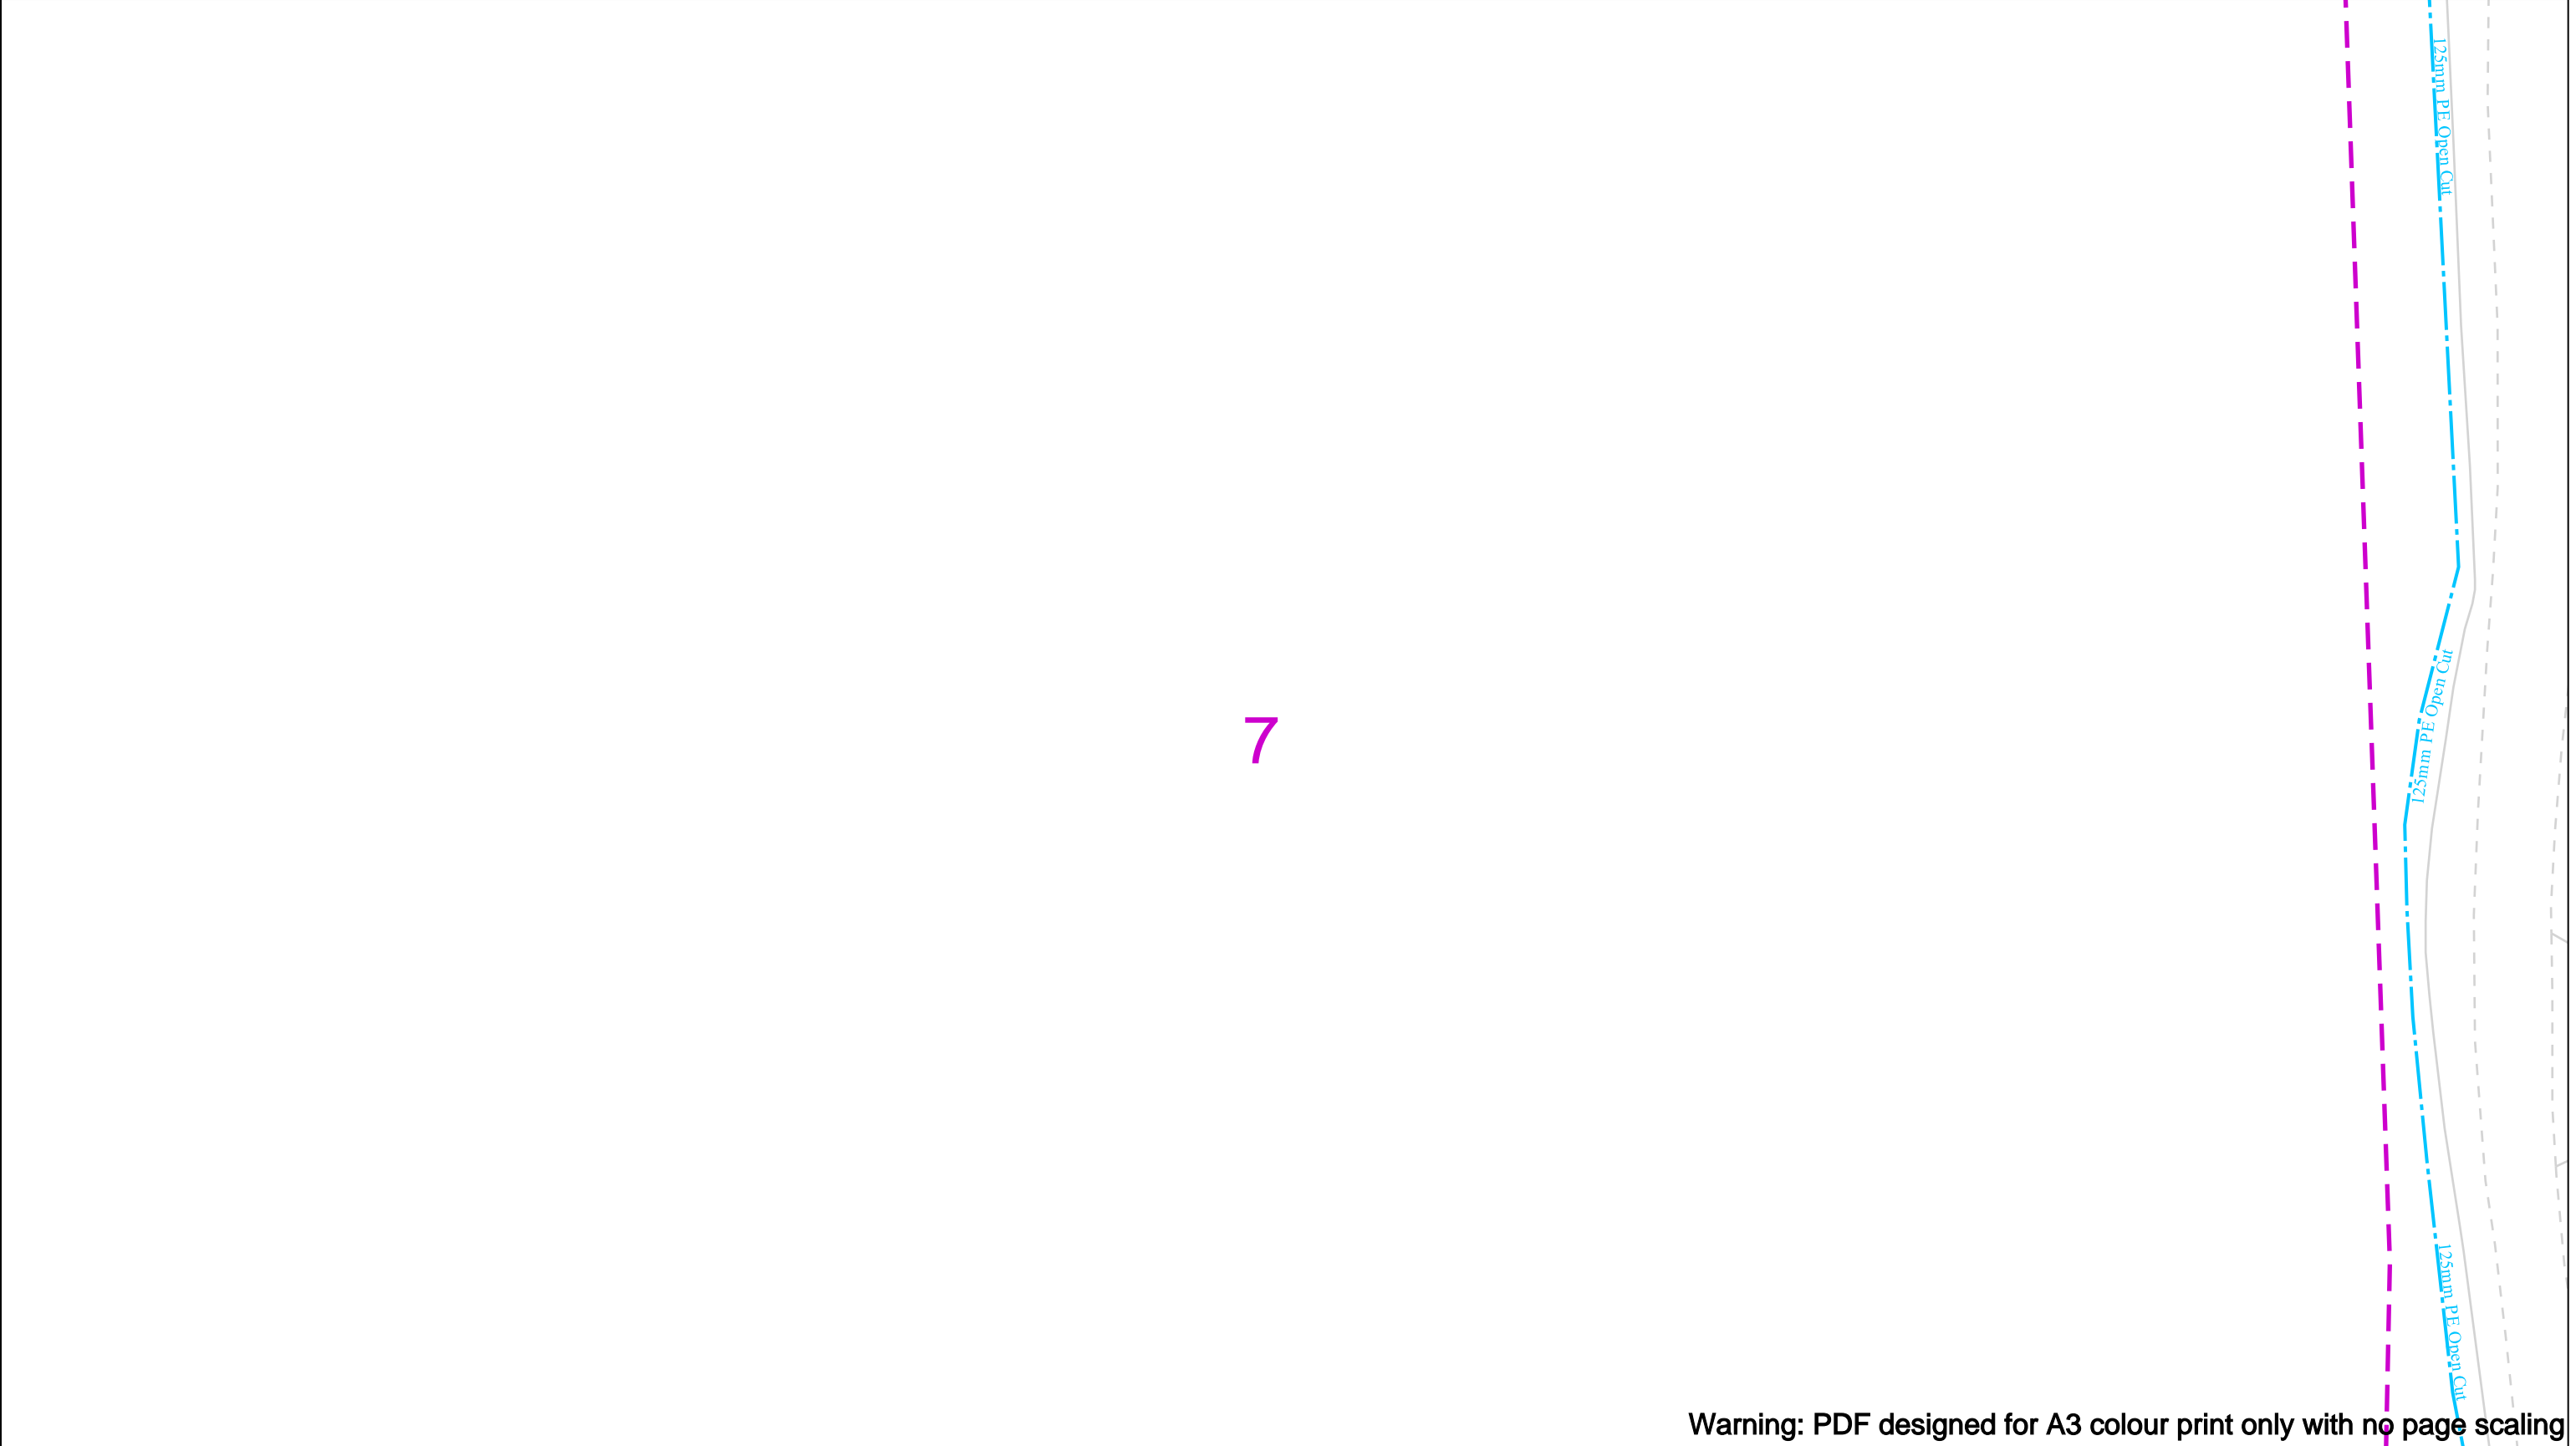

































Warning: PDF designed for A3 colour print only with no page scaling


<div><div>Date Requested: 04/07/2025 Job Reference: 37876007 Site Location: 554424 227878 Requested by: Mrs TDS Midlands Your Scheme/Reference: Mill Road</div><div>Scale: 1:500 (When plotted at A3)</div></div>		<div>View extent: 200m, 115m</div> <div>IMPORTANT NOTICES</div> <div>This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with H5(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</div>	<div>In case of an emergency call 0800 111 999</div> <div><div><div>Dig Sites</div><div><div><div>—</div>LP Mains</div><div><div>— — —</div>MP Mains</div><div><div>— — —</div>IP Mains</div><div><div>— — —</div>LHP Mains</div></div><div><div><div>⊗</div>Valve</div><div><div>∨</div>Depth of cover</div><div><div>○</div>Syphon</div></div><div><div><div>— — — —</div>Area:</div><div><div>— — — —</div>Line:</div><div><div><div>⬇</div>Diameter Change</div><div><div> </div>Material Change</div><div><div>!</div>Out of Standard Service</div></div></div></div></div> <div><div>Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following:</div><div><div>• Identification of shallow services</div><div>• Identification of dual services</div><div>• Recording of non-perpendicular services</div></div><div>A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.</div></div>		<div><div>Cadent</div><div>Your Gas Network</div></div>
<div>Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886</div>					



Warning: PDF designed for A3 colour print only with no page scaling


	View extent: 200m, 115m	<b>In case of an emergency call 0800 111 999</b>		<div data-bbox="2412 1728 2896 1927"><p data-bbox="2487 1885 2837 1927">Your Gas Network</p></div>						
<p>Date Requested: 04/07/2025 Job Reference: 37876007 Site Location: 554424 227878 Requested by: Mrs TDS Midlands Your Scheme/Reference: Mill Road</p> <p>Scale: 1:500 (When plotted at A3)</p>	<p>IMPORTANT NOTICES</p> <p>This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with H5(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</p>	<div data-bbox="1018 1728 1774 1755">50m</div> <table><tr><td data-bbox="1018 1780 1299 1812"><b>Dig Sites</b></td><td data-bbox="1344 1780 1498 1812">Area: </td><td data-bbox="1528 1780 1682 1812">Line: </td></tr><tr><td data-bbox="1018 1854 1299 1969"> LP Mains  MP Mains  IP Mains  LHP Mains</td><td data-bbox="1314 1854 1498 2001"> Valve  Depth of cover  Syphon</td><td data-bbox="1528 1854 1774 2001"> Diameter Change  Material Change  Out of Standard Service</td></tr></table>			<b>Dig Sites</b>	Area: 	Line: 	 LP Mains  MP Mains  IP Mains  LHP Mains	 Valve  Depth of cover  Syphon	 Diameter Change  Material Change  Out of Standard Service
<b>Dig Sites</b>	Area: 	Line: 								
 LP Mains  MP Mains  IP Mains  LHP Mains	 Valve  Depth of cover  Syphon	 Diameter Change  Material Change  Out of Standard Service								
<p>Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following:</p> <ul style="list-style-type: none"><li>• Identification of shallow services</li><li>• Identification of dual services</li><li>• Recording of non-perpendicular services</li></ul> <p>A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.</p>										

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

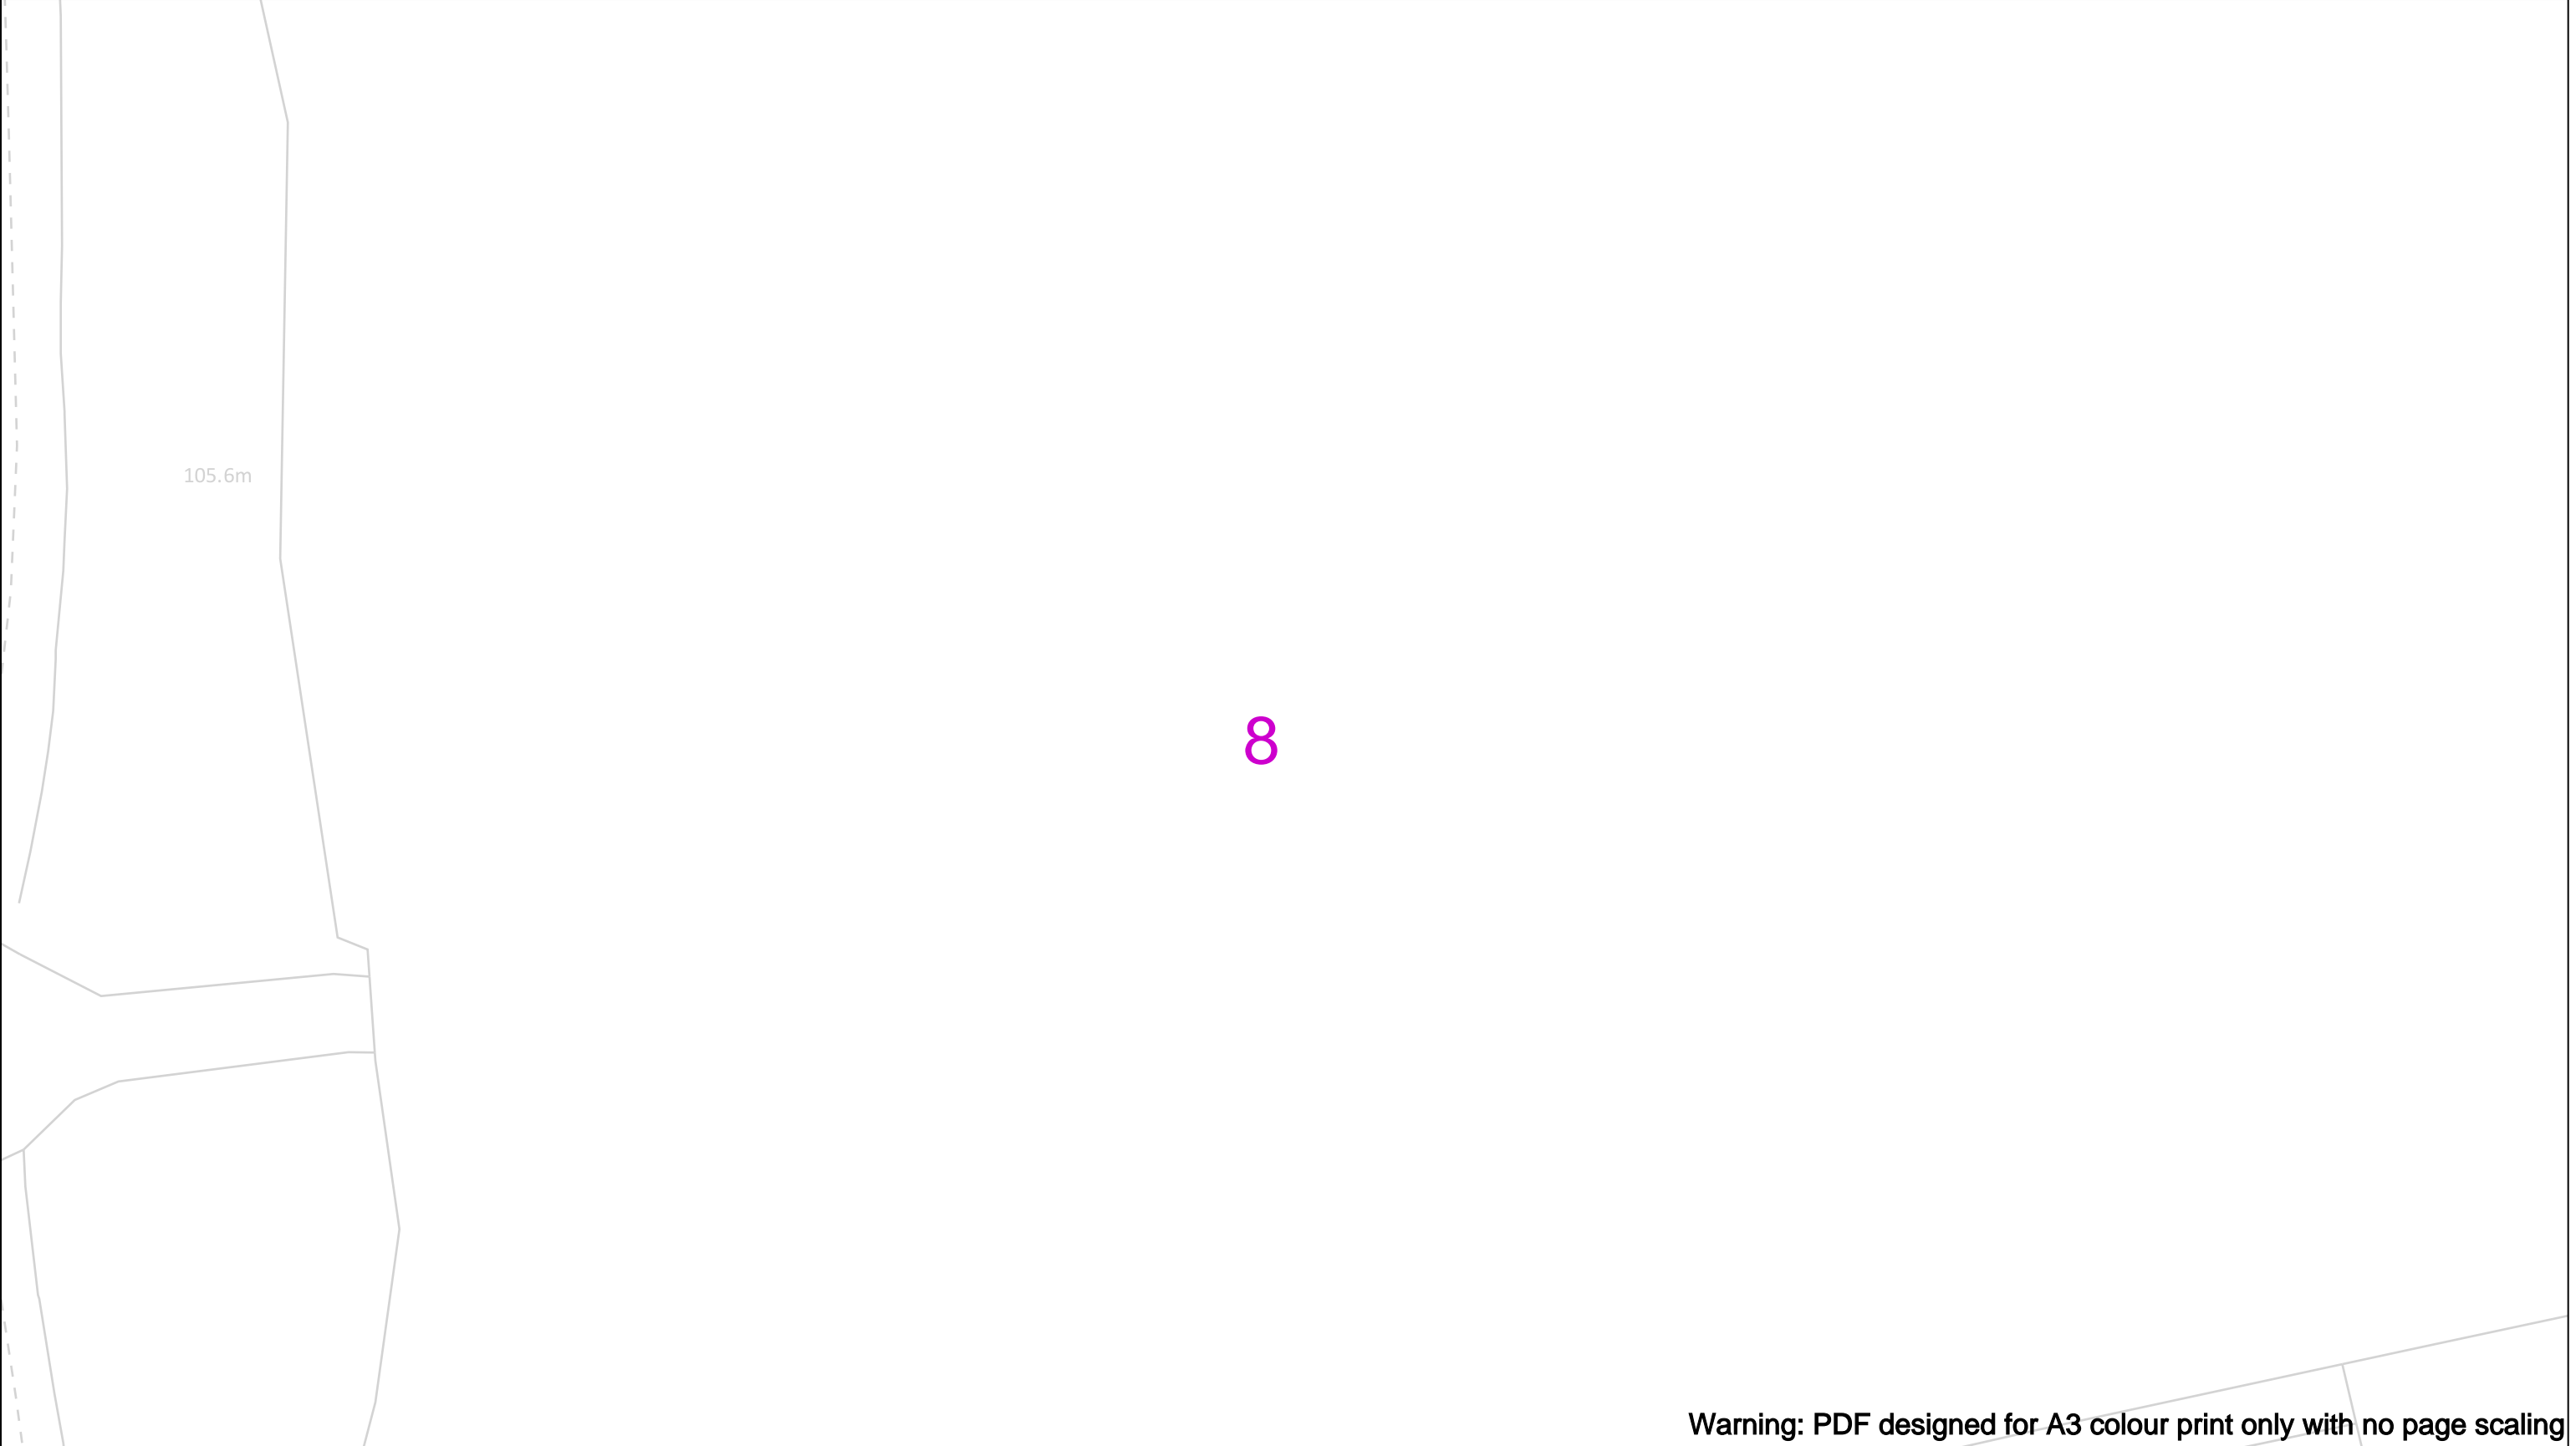





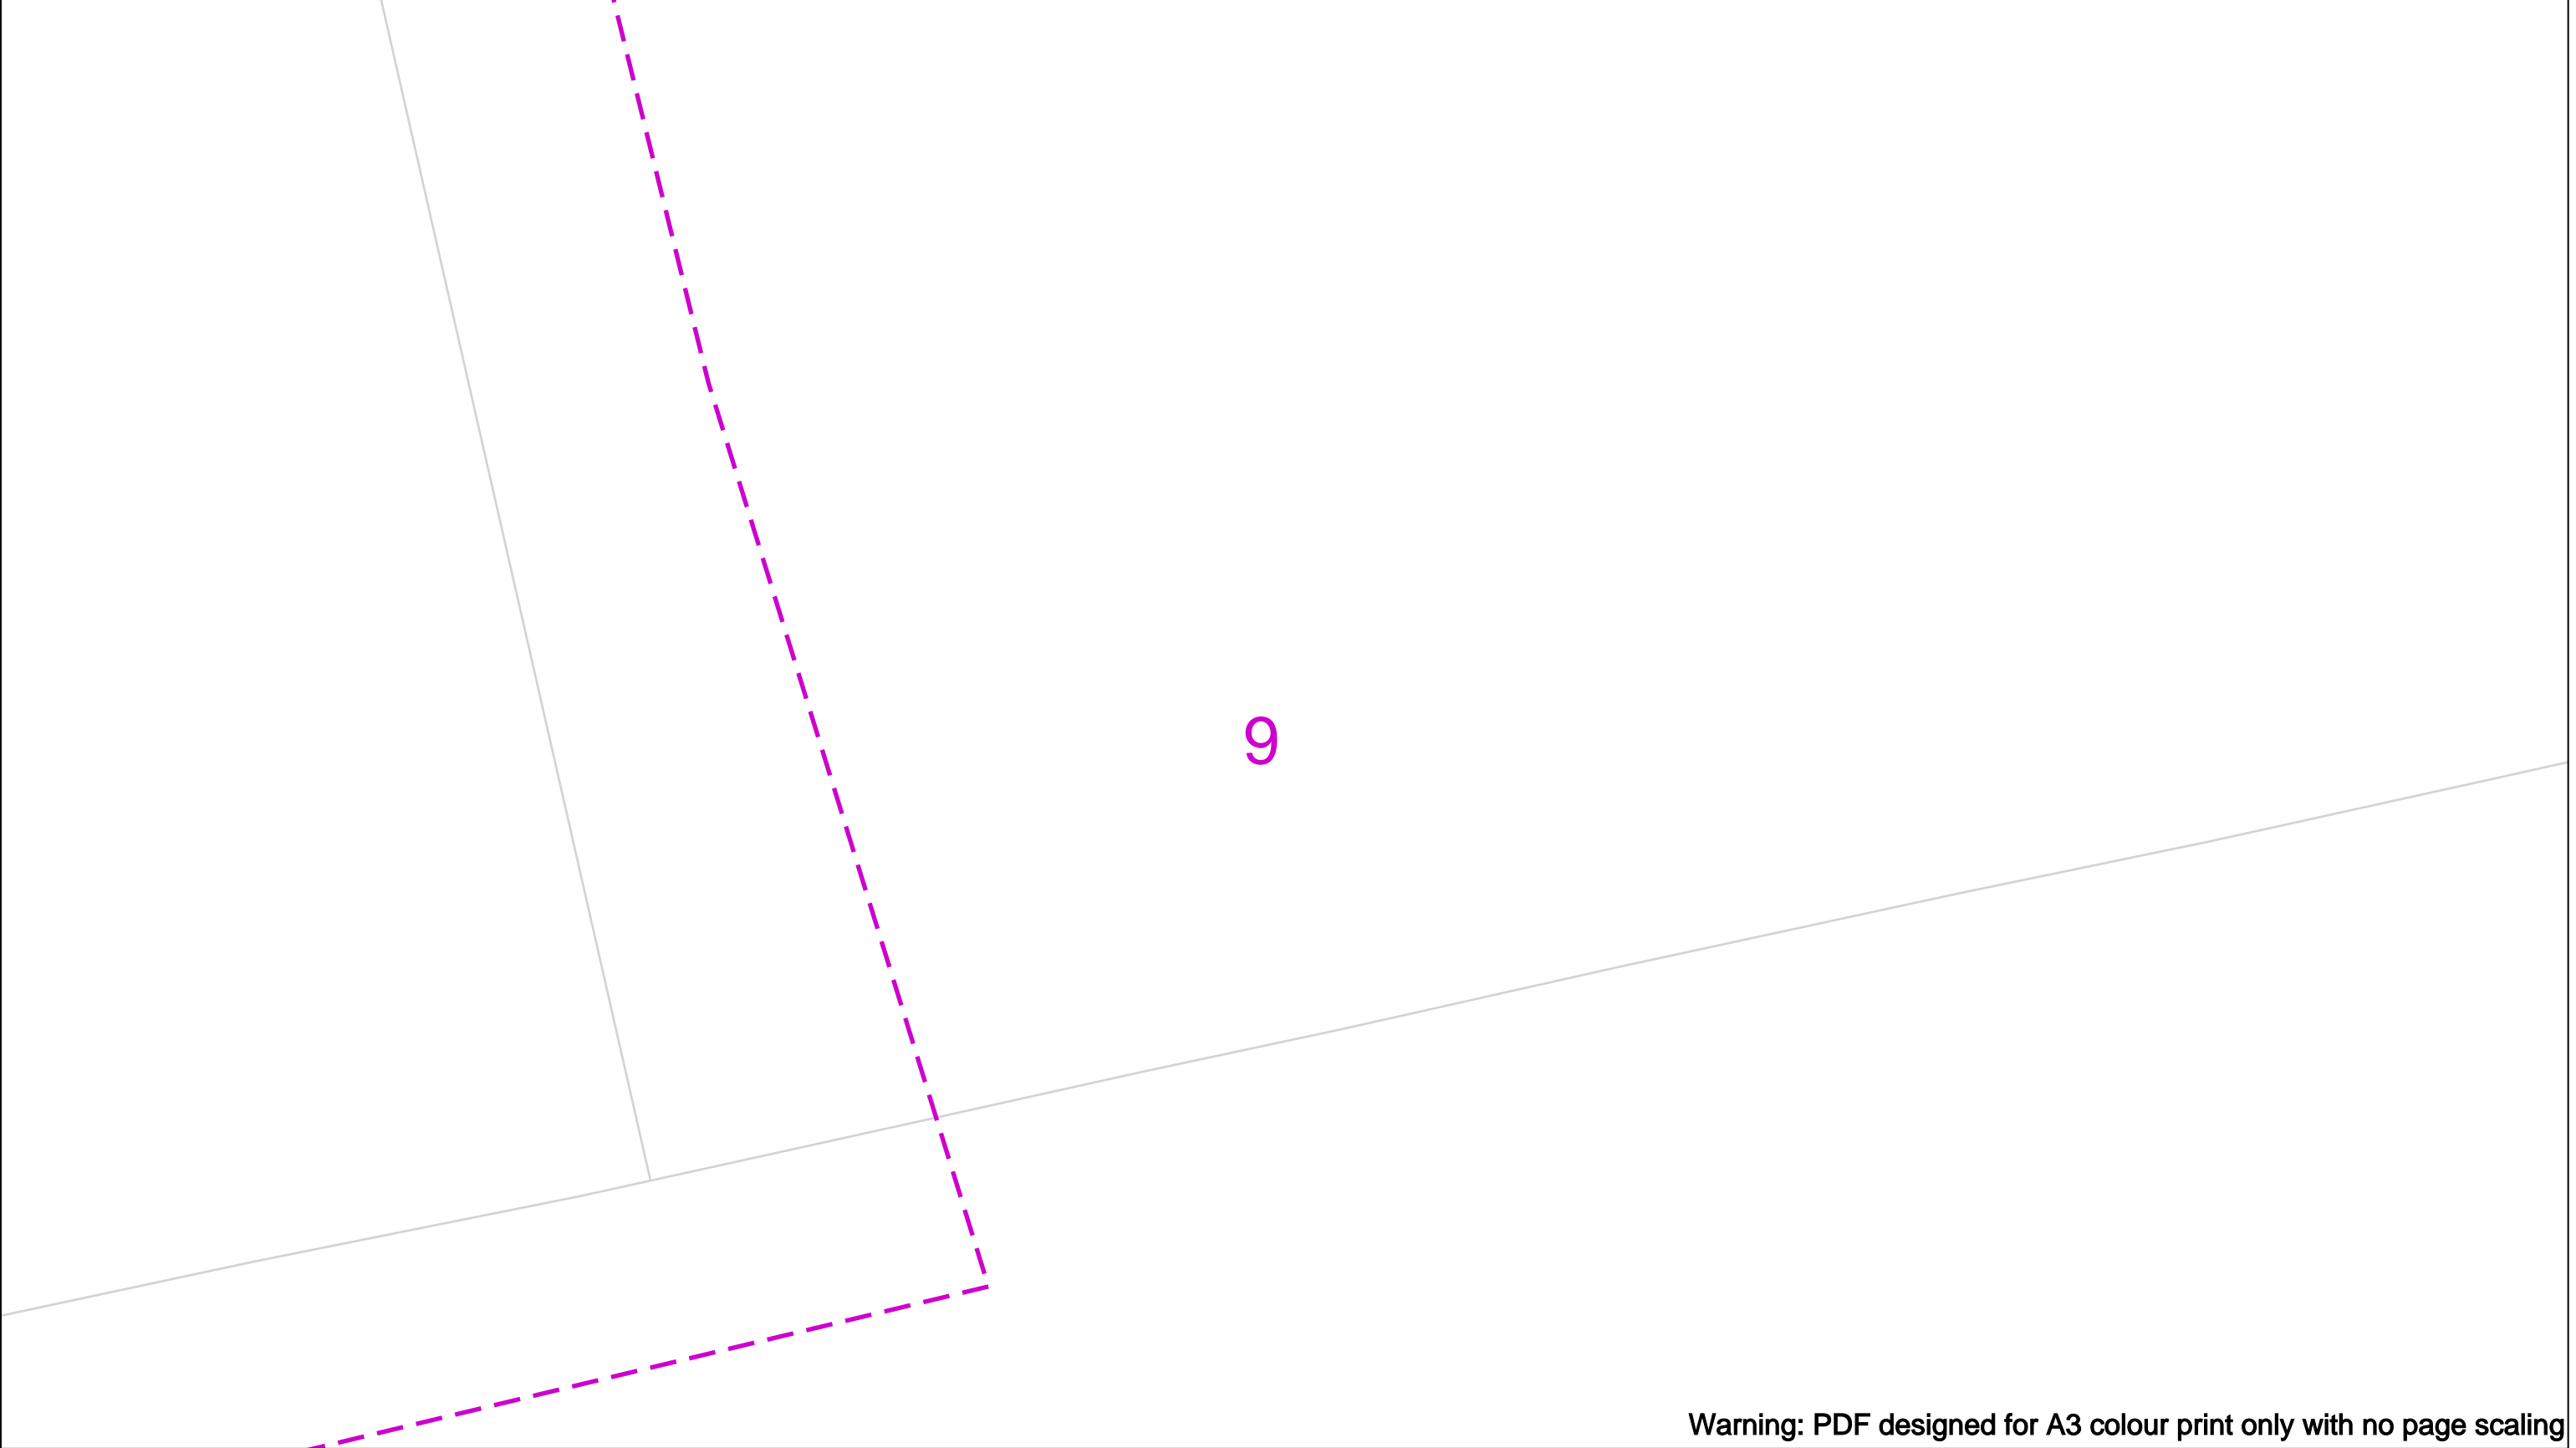

































Warning: PDF designed for A3 colour print only with no page scaling


		View extent: 200m, 115m		In case of an emergency call 0800 111 999		<div>Cadent</div> <div>Your Gas Network</div>
Date Requested: 04/07/2025 Job Reference: 37876007 Site Location: 554424 227878 Requested by: Mrs TDS Midlands Your Scheme/Reference: Mill Road		IMPORTANT NOTICES  This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with H5(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.		<div><div>50m</div><div>Dig Sites</div><div><div><div>—</div>LP Mains</div><div><div>- -</div>MP Mains</div><div><div>- - -</div>IP Mains</div><div><div>- - - -</div>LHP Mains</div></div><div><div><div>⊗</div>Valve</div><div><div>∨</div>Depth of cover</div><div><div>○</div>Syphon</div></div><div><div><div>- - - -</div>Area:</div><div><div>- - - -</div>Line:</div></div><div><div><div>⬇</div>Diameter Change</div><div><div> </div>Material Change</div><div><div>!</div>Out of Standard Service</div></div></div>		
Scale: 1:500 (When plotted at A3)				<div>Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information.</div> <div>Out-of-standard service symbology may be used to indicate one or more of the following:</div> <ul style="list-style-type: none"><li>• Identification of shallow services</li><li>• Identification of dual services</li><li>• Recording of non-perpendicular services</li></ul> <div>A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.</div>		
Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886						









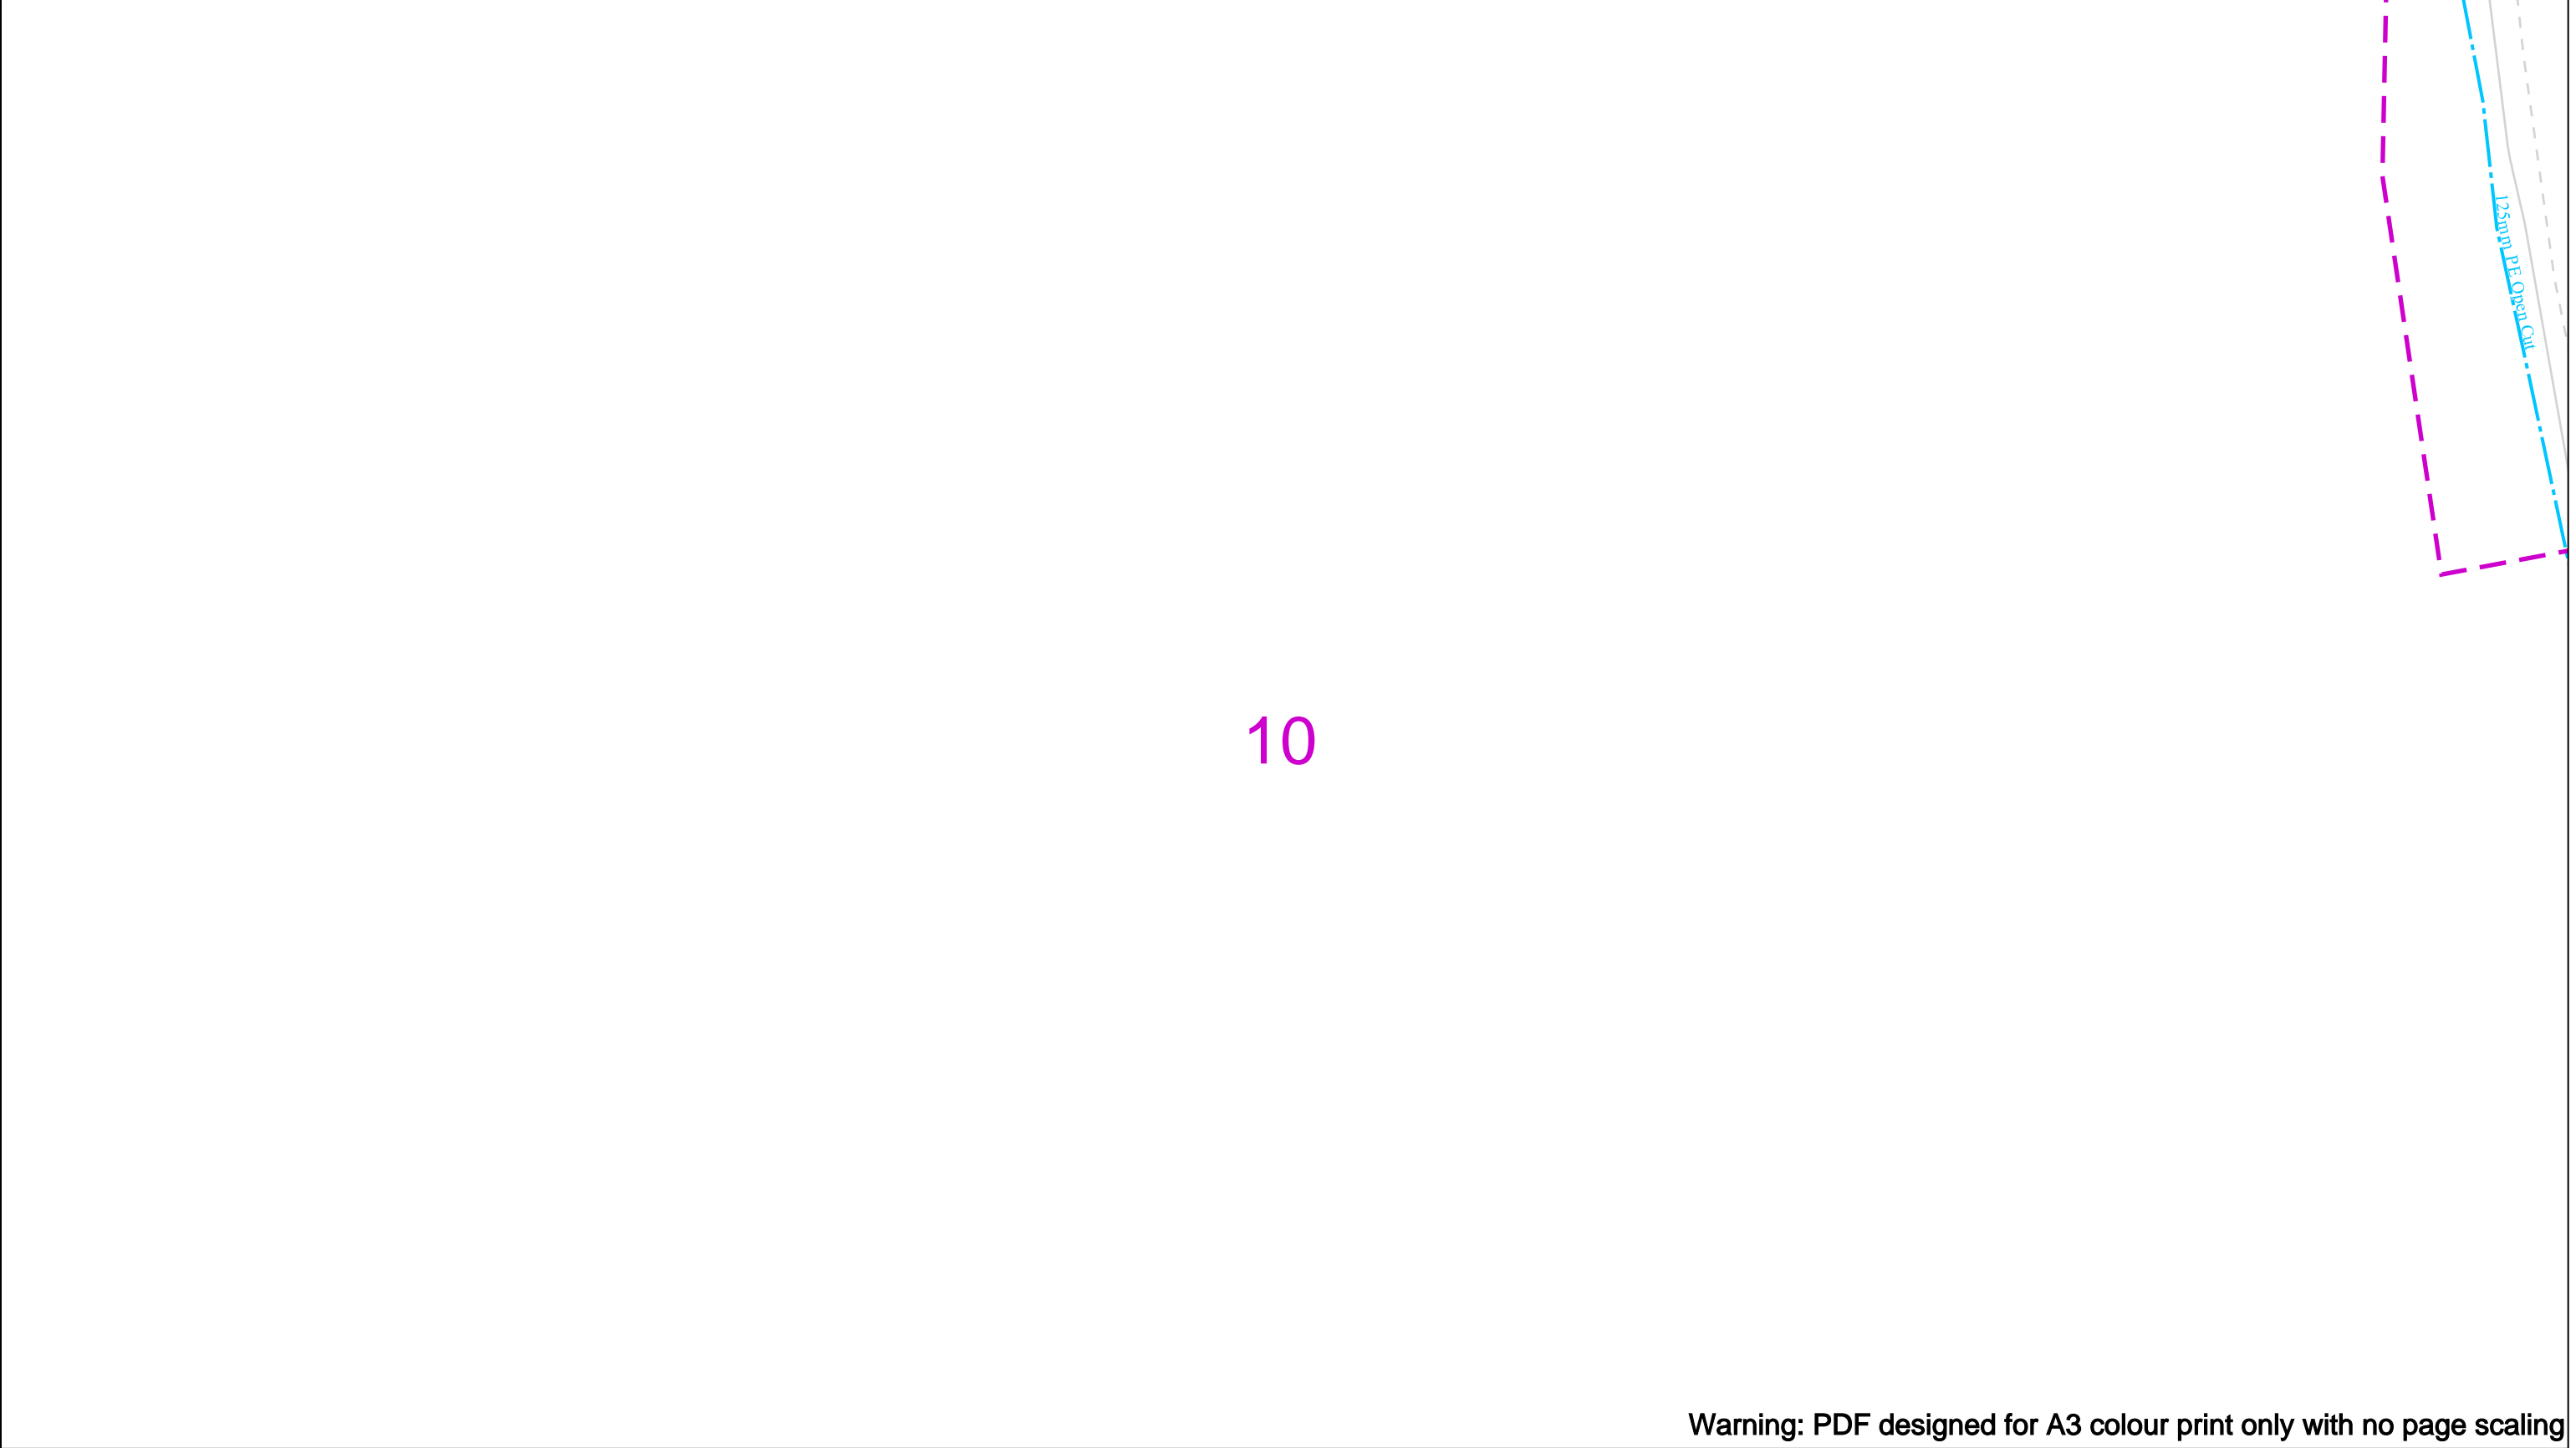































Warning: PDF designed for A3 colour print only with no page scaling

	View extent: 200m, 115m	<b>In case of an emergency call 0800 111 999</b>		<div> Your Gas Network</div>																	
<div>Date Requested: 04/07/2025 Job Reference: 37876007 Site Location: 554424 227878 Requested by: Mrs TDS Midlands Your Scheme/Reference: Mill Road</div>	<b>IMPORTANT NOTICES</b>  This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with H5(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.	<div>50m</div> <table><tr><td><b>Dig Sites</b></td><td>Area: </td><td>Line: </td><td rowspan="4"><div>Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following:<ul style="list-style-type: none"><li>• Identification of shallow services</li><li>• Identification of dual services</li><li>• Recording of non-perpendicular services</li></ul>A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.</div></td></tr><tr><td> LP Mains</td><td> Valve</td><td> Diameter Change</td></tr><tr><td> MP Mains</td><td> Depth of cover</td><td> Material Change</td></tr><tr><td> IP Mains</td><td> Syphon</td><td> Out of Standard Service</td></tr><tr><td> LHP Mains</td><td></td><td></td><td></td></tr></table>			<b>Dig Sites</b>	Area: 	Line: 	<div>Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following:<ul style="list-style-type: none"><li>• Identification of shallow services</li><li>• Identification of dual services</li><li>• Recording of non-perpendicular services</li></ul>A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.</div>	 LP Mains	 Valve	 Diameter Change	 MP Mains	 Depth of cover	 Material Change	 IP Mains	 Syphon	 Out of Standard Service	 LHP Mains			
<b>Dig Sites</b>		Area: 	Line: 		<div>Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following:<ul style="list-style-type: none"><li>• Identification of shallow services</li><li>• Identification of dual services</li><li>• Recording of non-perpendicular services</li></ul>A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.</div>																
 LP Mains	 Valve	 Diameter Change																			
 MP Mains	 Depth of cover	 Material Change																			
 IP Mains	 Syphon	 Out of Standard Service																			
 LHP Mains																					
Scale: 1:500 (When plotted at A3)																					


Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886











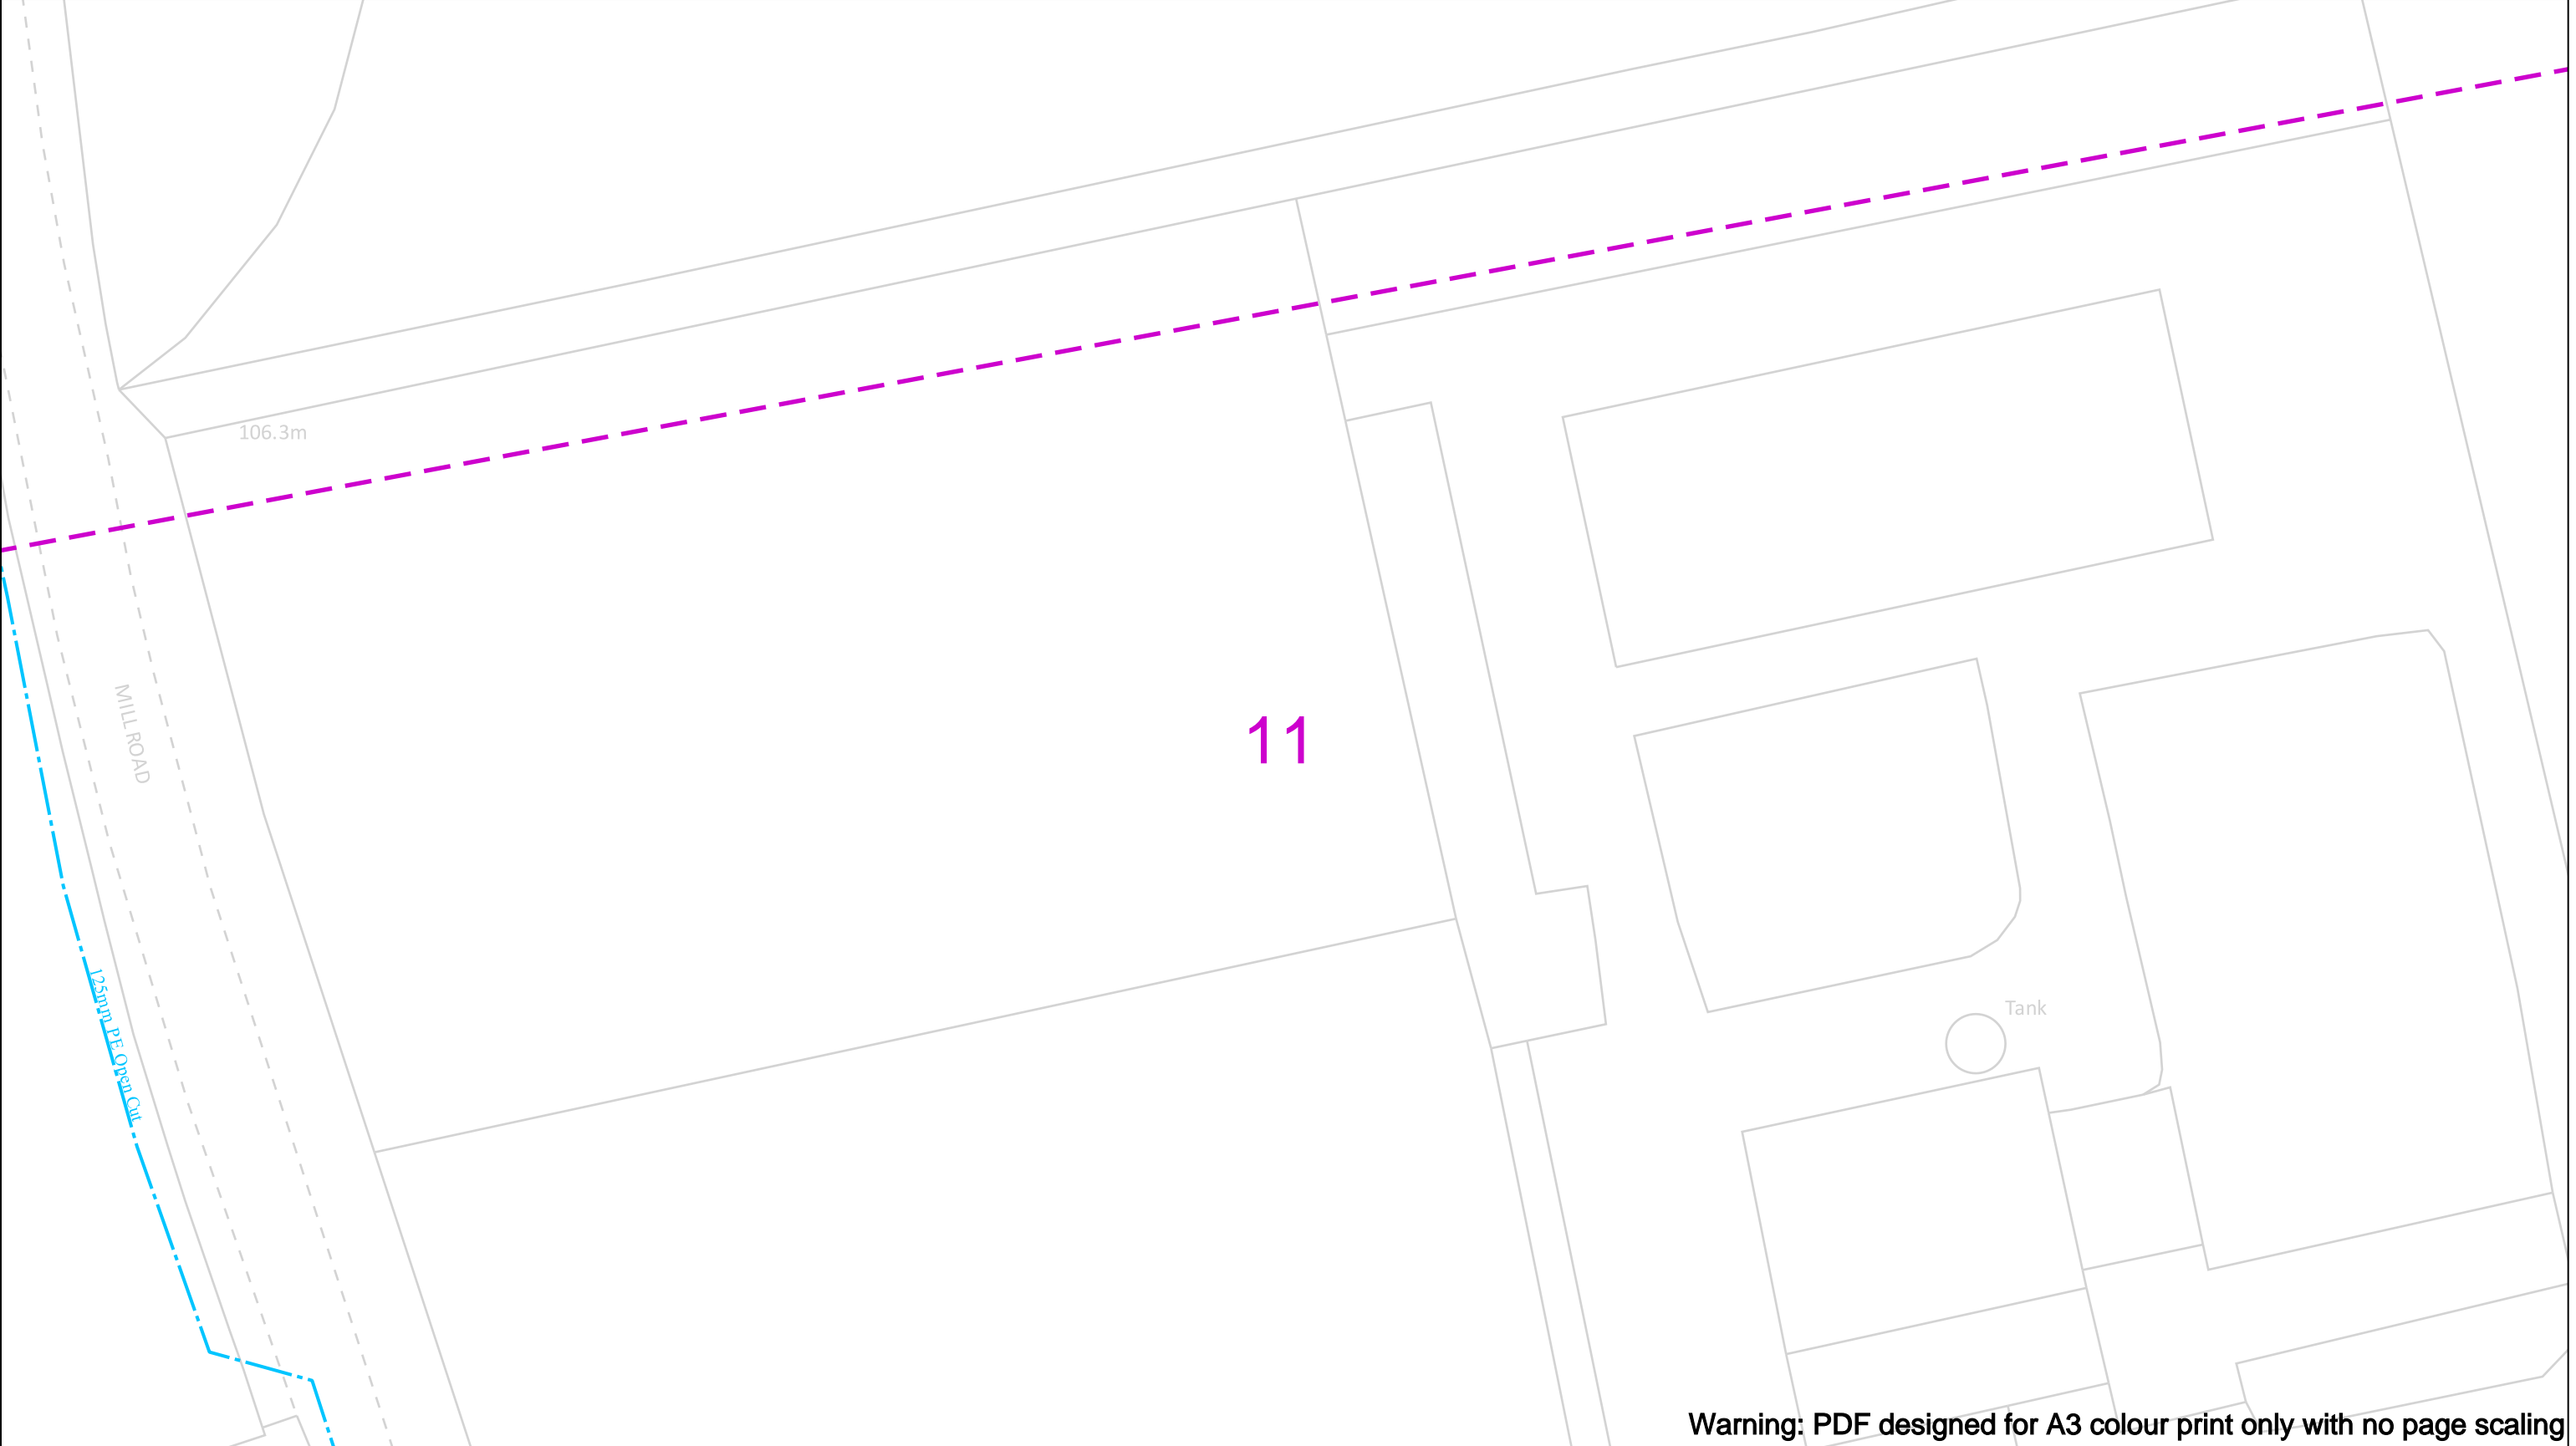





























Warning: PDF designed for A3 colour print only with no page scaling

	View extent: 200m, 115m	<b>In case of an emergency call 0800 111 999</b>		 <b>Your Gas Network</b>																		
Date Requested: 04/07/2025 Job Reference: 37876007 Site Location: 554424 227878 Requested by: Mrs TDS Midlands Your Scheme/Reference: Mill Road	IMPORTANT NOTICES  This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with H5(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.	<div>50m</div> <table><tr><td><b>Dig Sites</b></td><td>Area: </td><td>Line: </td><td></td></tr><tr><td> LP Mains</td><td> Valve</td><td> Diameter Change</td><td rowspan="3">Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following:<ul style="list-style-type: none"><li>• Identification of shallow services</li><li>• Identification of dual services</li><li>• Recording of non-perpendicular services</li></ul>A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.</td></tr><tr><td> MP Mains</td><td> Depth of cover</td><td> Material Change</td></tr><tr><td> IP Mains</td><td> Syphon</td><td> Out of Standard Service</td></tr><tr><td> LHP Mains</td><td></td><td></td><td></td></tr></table>			<b>Dig Sites</b>	Area: 	Line: 		 LP Mains	 Valve	 Diameter Change	Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following: <ul style="list-style-type: none"><li>• Identification of shallow services</li><li>• Identification of dual services</li><li>• Recording of non-perpendicular services</li></ul> A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.	 MP Mains	 Depth of cover	 Material Change	 IP Mains	 Syphon	 Out of Standard Service	 LHP Mains			
<b>Dig Sites</b>	Area: 	Line: 																				
 LP Mains	 Valve	 Diameter Change	Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following: <ul style="list-style-type: none"><li>• Identification of shallow services</li><li>• Identification of dual services</li><li>• Recording of non-perpendicular services</li></ul> A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.																			
 MP Mains	 Depth of cover	 Material Change																				
 IP Mains	 Syphon	 Out of Standard Service																				
 LHP Mains																						
Scale: 1:500 (When plotted at A3)																						


Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886



Warning: PDF designed for A3 colour print only with no page scaling

	View extent: 200m, 115m	<b>In case of an emergency call 0800 111 999</b>		<div data-bbox="2412 1724 2896 1927"> Your Gas Network</div>			
<p>Date Requested: 04/07/2025 Job Reference: 37876007 Site Location: 554424 227878 Requested by: Mrs TDS Midlands Your Scheme/Reference: Mill Road</p> <p>Scale: 1:500 (When plotted at A3)</p>	<p>IMPORTANT NOTICES</p> <p>This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with H5(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</p>	<div data-bbox="1012 1724 1774 2007"><div data-bbox="1012 1724 1774 1759">50m</div><table><tr><td data-bbox="1012 1780 1299 1969"><b>Dig Sites</b>  LP Mains  MP Mains  IP Mains  LHP Mains</td><td data-bbox="1308 1780 1498 2007"><b>Area:</b>   Valve  Depth of cover  Syphon</td><td data-bbox="1507 1780 1774 2007"><b>Line:</b>   Diameter Change  Material Change  Out of Standard Service</td></tr></table></div>			<b>Dig Sites</b>  LP Mains  MP Mains  IP Mains  LHP Mains	<b>Area:</b>   Valve  Depth of cover  Syphon	<b>Line:</b>   Diameter Change  Material Change  Out of Standard Service
<b>Dig Sites</b>  LP Mains  MP Mains  IP Mains  LHP Mains	<b>Area:</b>   Valve  Depth of cover  Syphon	<b>Line:</b>   Diameter Change  Material Change  Out of Standard Service					
<p>Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following:</p> <ul style="list-style-type: none"><li>• Identification of shallow services</li><li>• Identification of dual services</li><li>• Recording of non-perpendicular services</li></ul> <p>A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.</p>							

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

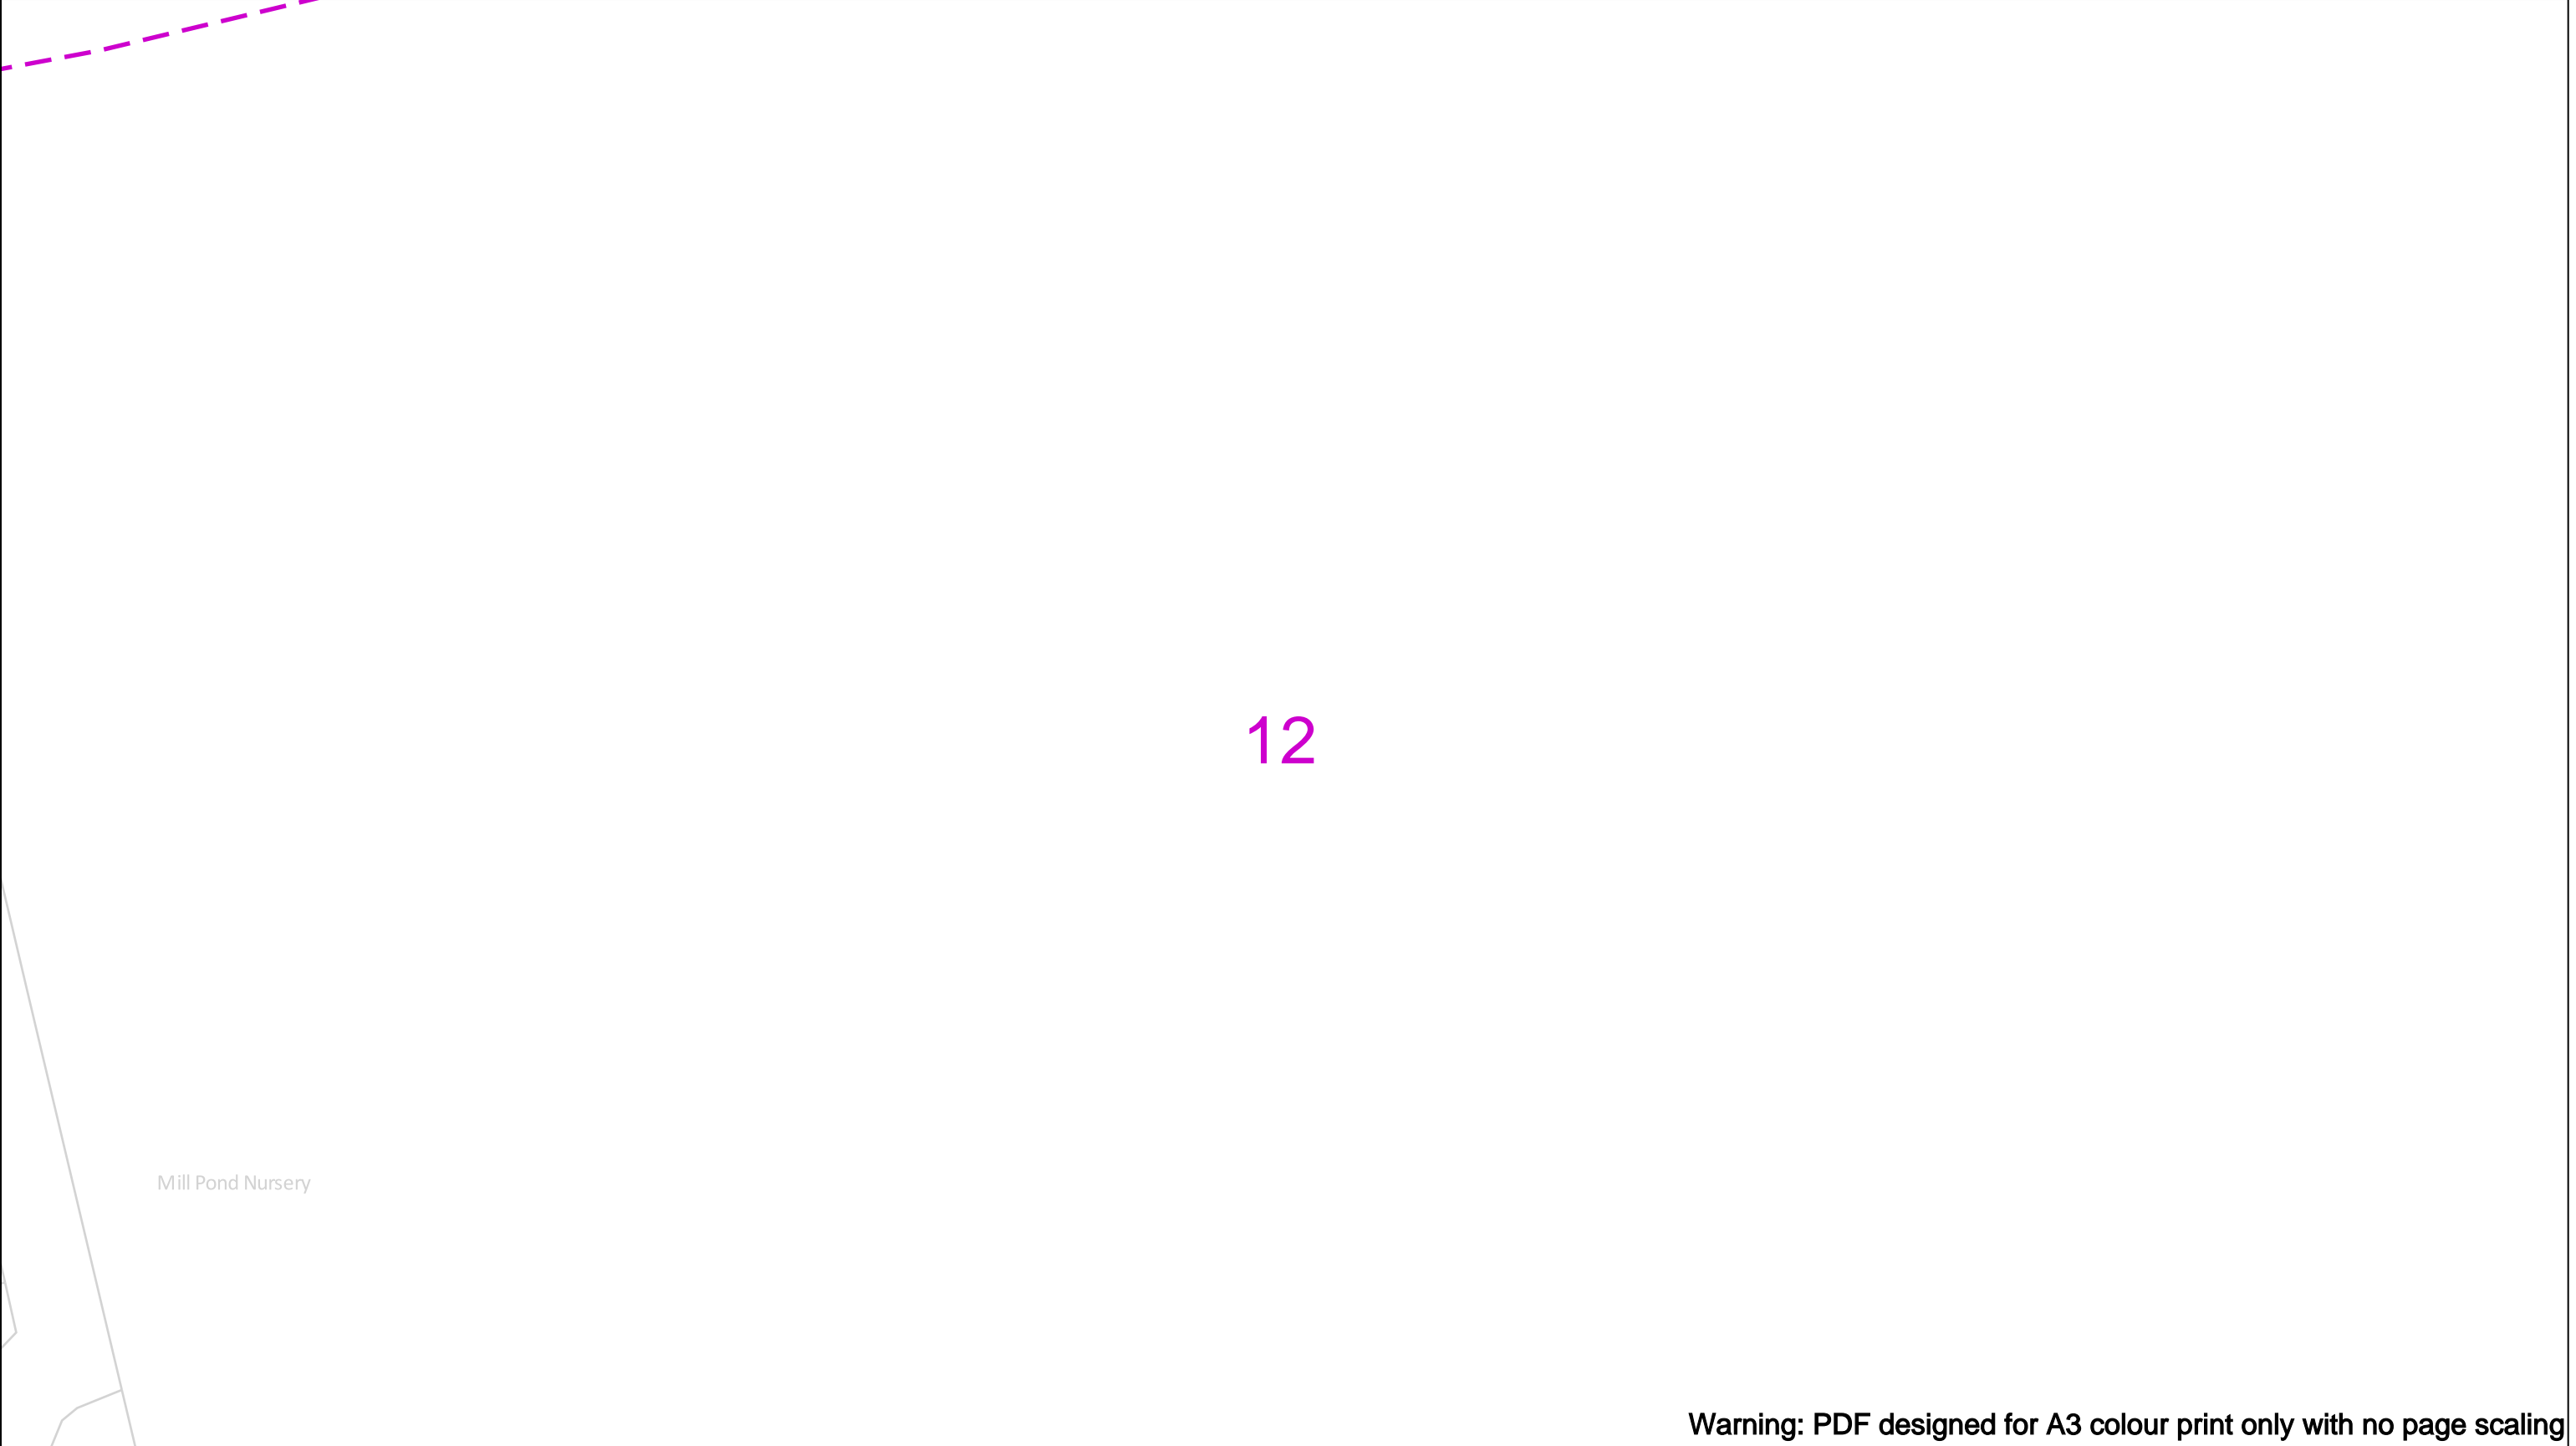

Warning: PDF designed for A3 colour print only with no page scaling

<div><div>Date Requested: 04/07/2025 Job Reference: 37876007 Site Location: 554424 227878 Requested by: Mrs TDS Midlands Your Scheme/Reference: Mill Road</div><div>Scale: 1:500 (When plotted at A3)</div></div>		<div>View extent: 200m, 115m</div> <div>IMPORTANT NOTICES</div> <div>This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with H5(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.</div>	<div>In case of an emergency call 0800 111 999</div> <div><div><div>Dig Sites</div><div><div><div>—</div><div>—</div><div>—</div><div>—</div></div><div><div>LP Mains</div><div>MP Mains</div><div>IP Mains</div><div>LHP Mains</div></div></div><div><div>Area: <div>---</div></div><div>Line: <div>---</div></div><div><div><div><div>⊗</div><div>Valve</div></div><div><div>∨</div><div>Depth of cover</div></div><div><div>○</div><div>Syphon</div></div></div><div><div><div><div>⚡</div><div>Diameter Change</div></div><div><div> </div><div>Material Change</div></div><div><div>!</div><div>Out of Standard Service</div></div></div></div></div><div><div>Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following:</div><div><div><div>• Identification of shallow services</div><div>• Identification of dual services</div><div>• Recording of non-perpendicular services</div></div><div>A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.</div></div></div></div></div></div>	<div><div>Cadent</div><div>Your Gas Network</div></div>
<div>Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886</div>				