

ISED DPC LOCATION & PLEASE REFER PLEASE REFER TO CIVIL TANKING AND RAISED DPC STANDARD DETAILS REFER TO B/12, A/SD/S10/B/22, A/SD/S10/B/38, A/SD/S10/B/39, A/SD/S10/B/41

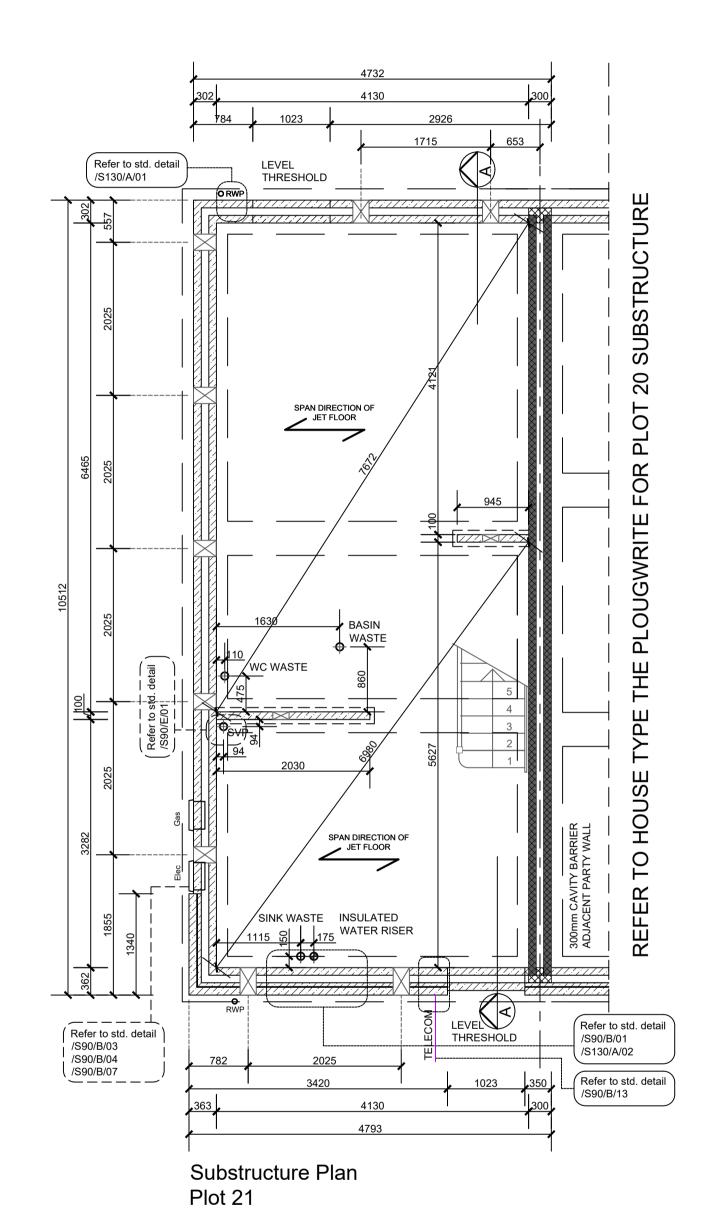

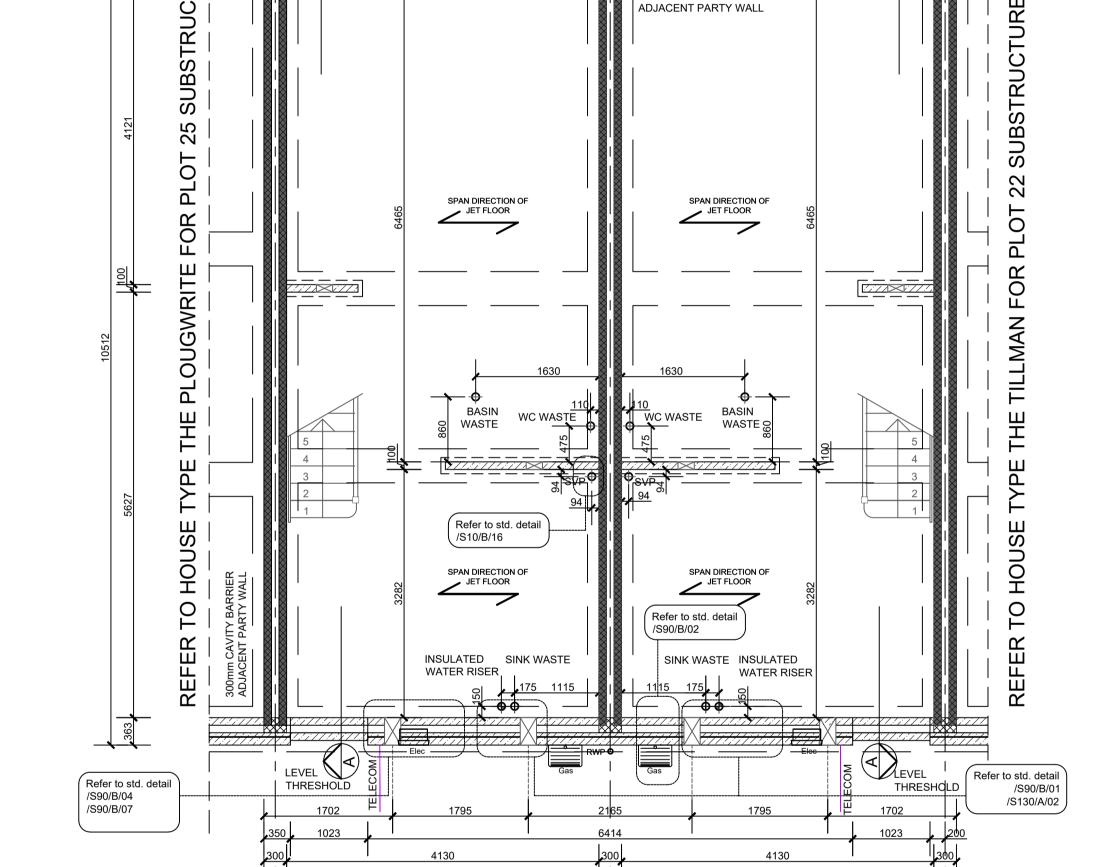

LEVEL THRESHOLD RWP 0

LEVEL

THRESHOLD

300mm CAVITY BARRIER

ADJACENT PARTY WALL

**EXTENT OF PLOT 23** 

Substructure Plan Plots 23 & 24

**EXTENT OF PLOT 24** 

Refer to std. detail

/S130/A/01

SUBSTRUCTURE WALL LEGEND (100 mm CAVITY)


GAS MEMBRANE REQUIRED:

SUB-GROUND WALL LEGEND REFER TO CURRENT CONSTRUCTION SPECIFICATION FOR FURTHER DETAILS

•	
	STANDARD EXTERNAL INSULATED CAVITY WALL (BELOW GROUND)
	100mm BLOCKS (7.3N/mm²) UP TO 150mm BELOW EXTERNAL GROUND LEVEL, THEN CLASS B ENGINEERING BRICKWORK (102.5mm) TO DPC LEVEL OR 150mm ADJACENT GROUND LEVEL WHERE LOCATED IN UNDER BUILT 100mm CAVITY WITH EXPANDED POLYSTYRENE BOARD (THERMAL CONDUCTIVITY 0.038 W/m²/°K) 100mm AERATED CONCRETE BLOCK / COURSING BRICKS (7.3N/mm²)
	PLINTH STANDARD EXTERNAL INSULATED CAVITY WALL (BELOW GROUND)
	100mm BLOCKS (7.3N/mm²) UP TO 150mm BELOW EXTERNAL GROUND LEVEL, THEN CLASS B ENGINEERING BRICKWORK (102.5mm) TO DPC LEVEL OR 150mm ADJACENT GROUND LEVEL WHERE LOCATED IN UNDER BUILT 50mm AERATED CONCRETE BLOCK / COURSING BRICKS (7.3N/mm²)
	100mm CAVITY WITH EXPANDED POLYSTYRENE BOARD (THERMAL CONDUCTIVITY 0.038 W/m²/°K) 100mm AERATED CONCRETE BLOCK / COURSING BRICKS (7.3N/mm²)
	INTERNAL BLOCKWORK PARTITION (BELOW GROUND)
V.5577.557	100MM BLOCKS (7.3N/mm²) (SUSPENDED GROUND FLOOR BEAM MANUFACTURER'S COURSING BLOCKS / BRICKS AS REQUIRED)
	PARTY WALL (BELOW GROUND)
	100 mm BLOCKS (7.3N/mm²) 100 mm CAVITY WITH EXPANDED POLYSTYRENE BOARD (THERMAL CONDUCTIVITY 0.038 W/M²/°K) 100 mm BLOCKS (7.3N/mm²)

MIN 2000g DPM/REINFORCED DPM REQUIRED TO JETFLOOR SYSTEM WITH JOINTS & PENETRATIONS SEALED AND UNDERFLOOR VENTING. ALL TO BE DESIGNED AND INSTALLED BY A COMPETENT SUBCONTRACTOR IN ACCORDANCE WITH BISON DETAILS, INSTALLATION VERIFICATION PROVIDED.

JET FLOOR SYSTEM

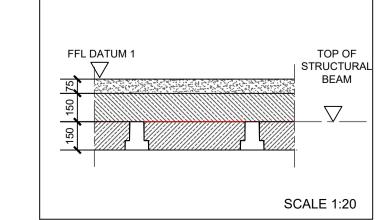

WADP Limited Registered in England No. 4564928
Registered office: Station House, Connaught Road, Brookwood,



RIBA CHARTERED PRACTICE NUMBER 20000159

Drawings not to be scaled. Work to figured dimensions only. All dimensions to be checked on site, and any discrepancies reported to the Architect immediately

All drawings are to be read in conjunction the BELLWAY Company Specification and Project Specifications, Company Standard Details and with the current Building Regulations and Codes of Practice.

It is the Contractor's responsibility to ensure that all works are carried out in accordance with the same.

All concrete work to be carried out in accordance with BS EN 1992-1-1:2004.

All brickwork and blockwork to be carried out in accordance with BS EN 1996-1-2:2005.

All structural steelwork to be carried out in accordance with BS EN 1993-1-1:2005 Steelwork to be Grade S275.

All structural timber to be used in accordance with BS EN 1995-1-1:2004 and is to be preservative treated in accordance with BS4072.

All plumbing to be in accordance with BS6700, BS EN 12056, BS6465:Part 1 and BS6367.

All glass falling within critical zones as defined by Part N of the Building Regulations is to be toughened or safety glass in accordance with BS EN 12600

All building works to be undertaken in accordance with Robust Enhanced Accredited Details.



## ARCHITECTS

62 Well Lane Horsell Woking Surrey GU21 4PS

Telephone: 01483 763028 e-mail info@wadp.co.uk



REGENT'S GATE VIRGINIA WATER SOUTH

THE BAKER Substructure

1:50 @ A1 50mm @ A1 March 2024

DP.659.022 BAKER 10

T2