



DO NOT SCALE



30.74

Area of mixed bushes
ave h=3.0

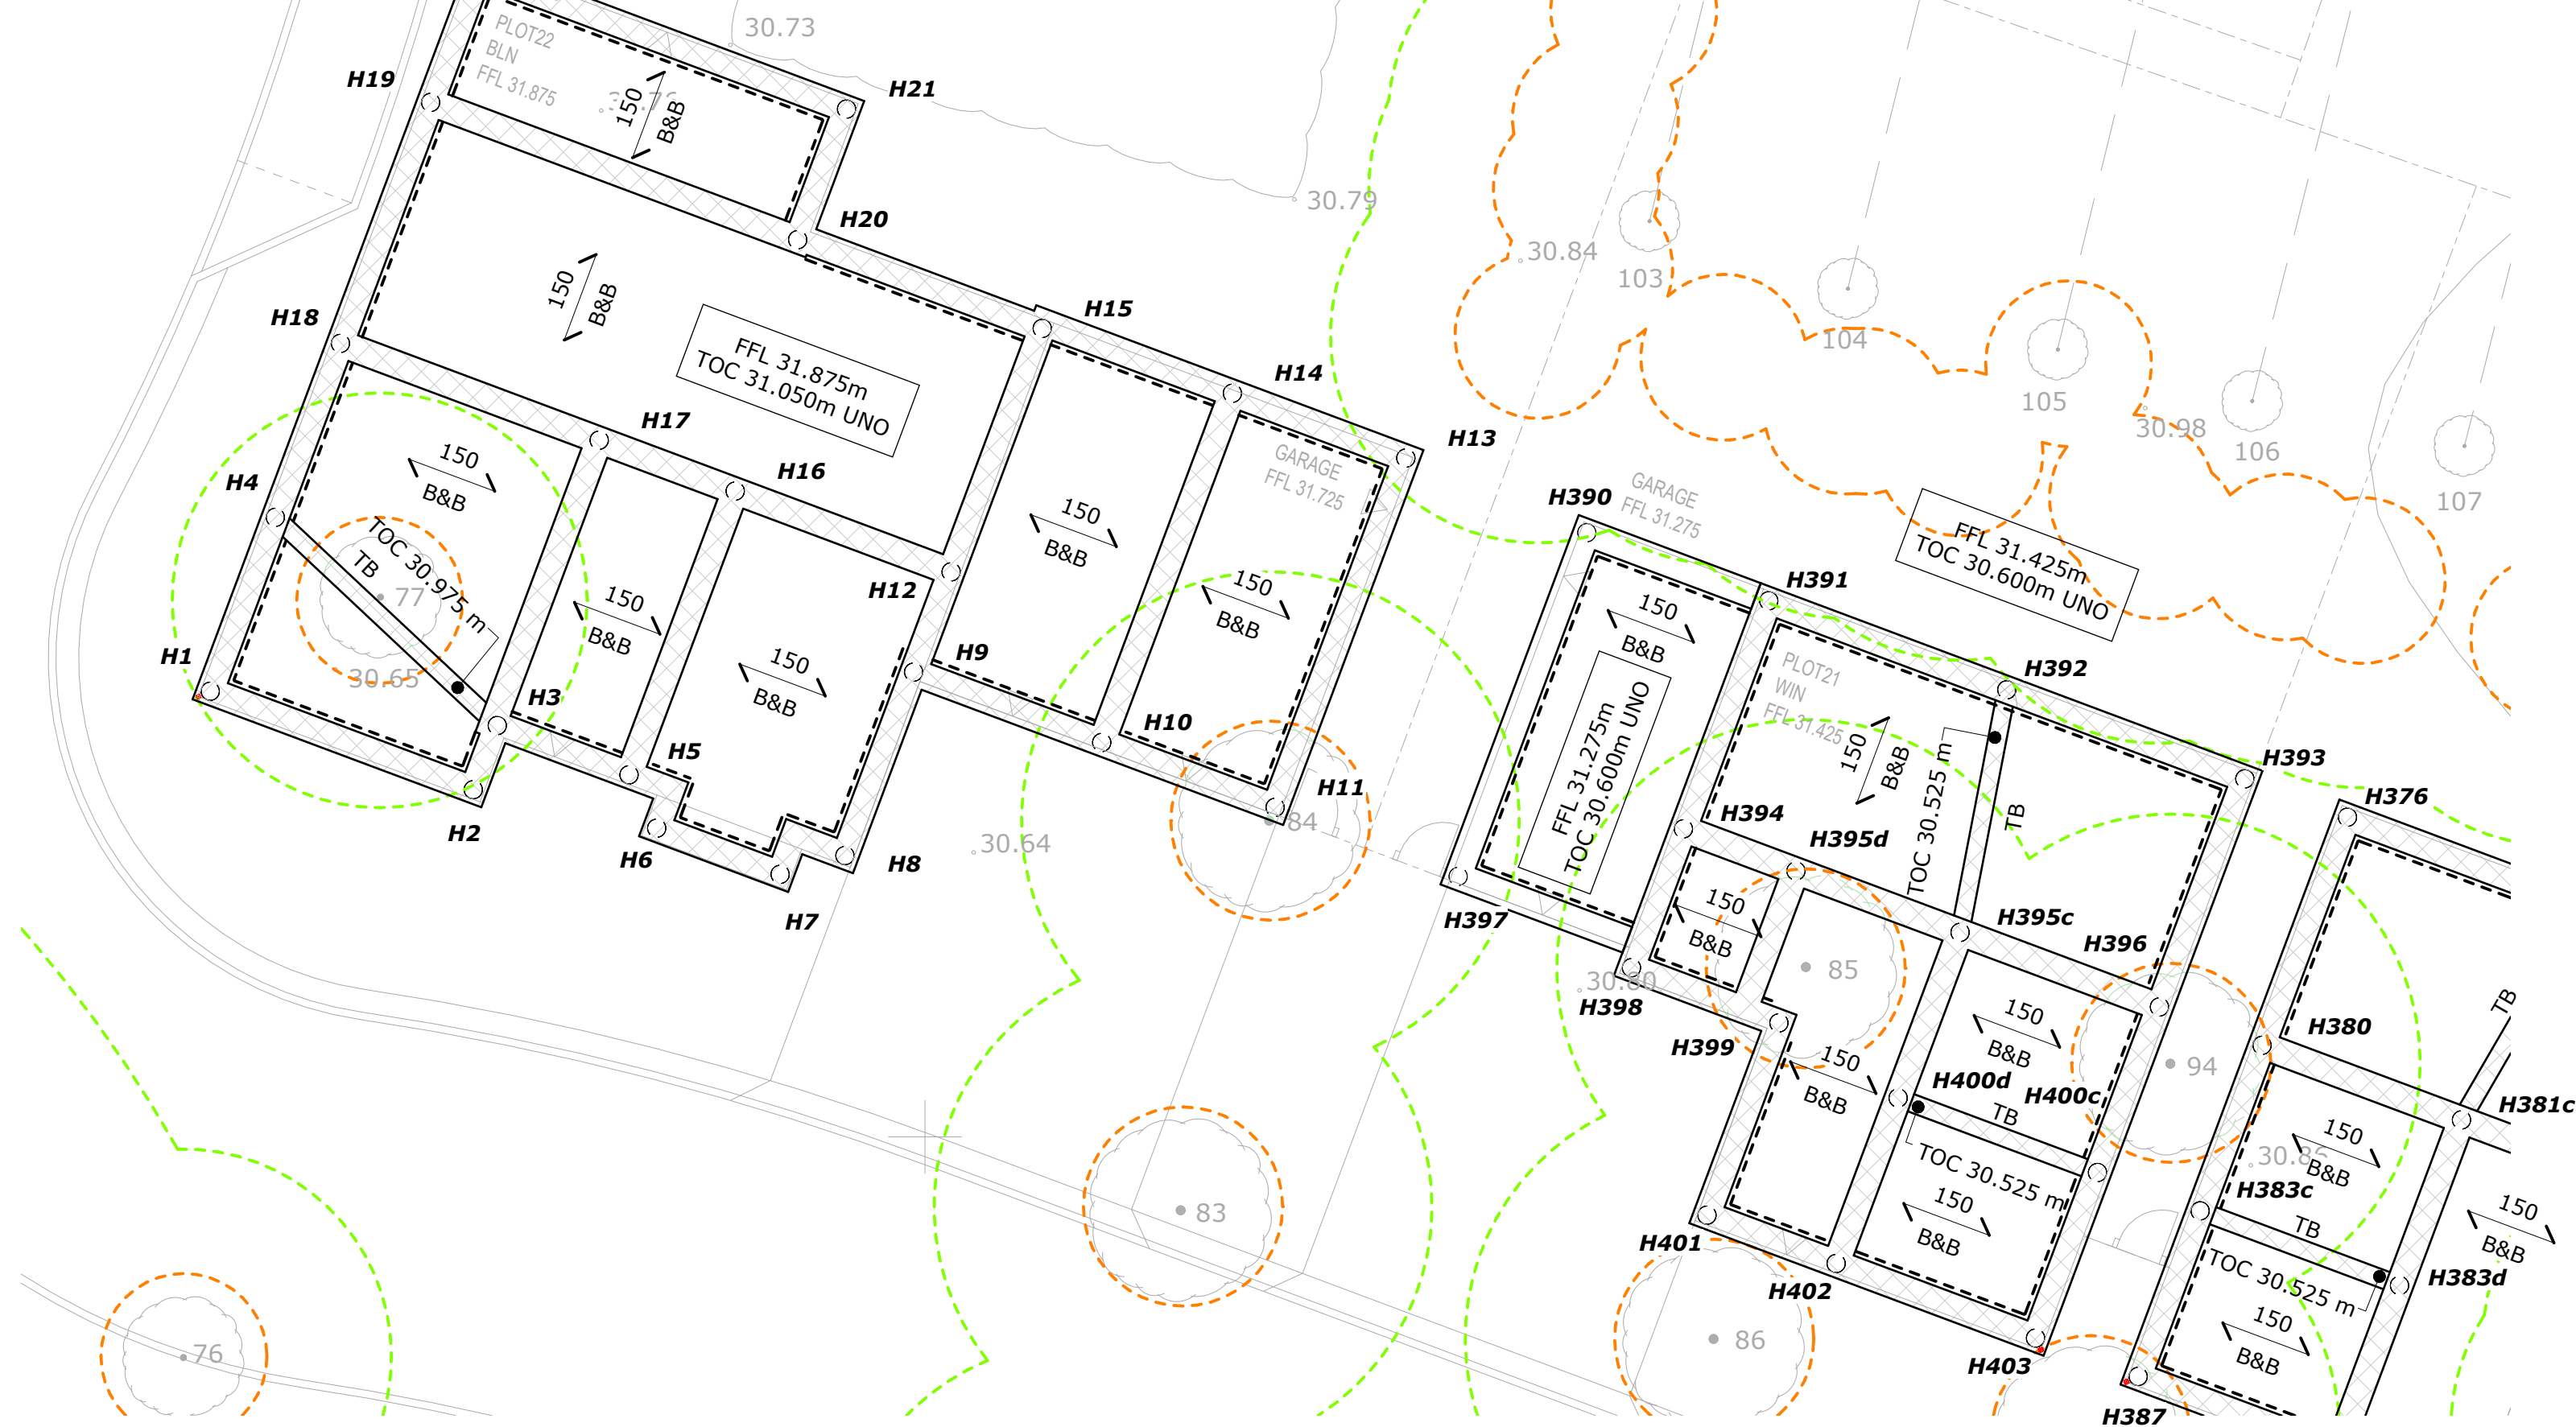

SAFETY HEALTH & ENVIRONMENTAL INFORMATION

THIS IS TO BE READ IN CONJUNCTION WITH RISK REGISTER DOCUMENT

It is a requirement that only experienced and competent contractors carry out the described, using a recognised safe method of working. The following are specific significant residual risks identified by the designer and are additional to those hazard/risks normally associated with this type of work.

CONSTRUCTION:

- ⚠ Differential Settlement - Foundations must extend 150mm into Bearing Material
- ⚠ Deep Excavations - Possible collapse of ground
- ⚠ Flooding risk - River Bourne 360m west of site
- ⚠ Contaminated ground potential

NO SETTING OUT INFORMATION IS SHOWN ON THIS DRAWING. FOUNDATION LOCATIONS ARE BASED ON ARCHITECTURAL HOUSETYPE LAYOUTS AT THE TIME OF DESIGN. FOR SETTING OUT OF FOUNDATIONS IN RELATION TO THE WALLS REFER TO ARCHITECTS HOUSETYPE DRAWINGS.

Load Description	Value
DEAD LOADS Self Weight Finishes Services	By Specialist 1.80 kN/m ² 0.30 kN/m ²
LIVE LOADS Typical Partitions Common Areas Bike Store Bin Store Plant Room	1.50 kN/m ² 0.50 kN/m ² 3.00 kN/m ² 3.00 kN/m ² 3.00 kN/m ² 7.50 kN/m ²
PRIVATE STAIR LOADING Live Load Add. Dead Load	1.50 kN/m ² 0.50 kN/m ²
BLOCK WALLS 140 Thick 215 Thick Brick Block Cavity Wall Brick Metsec Cavity Wall	2.50 kN/m ² 4.00 kN/m ² 3.85 kN/m ² 3.30 kN/m ²

Minimum Foundation Thicknesses	
Minimum Width	Minimum Thickness
<900mm	500mm
1050mm	550mm
1200mm	600mm
1350mm	650mm
1500mm	700mm
1650mm	825mm
1800mm	900mm

Key	Description
	Denotes minimum 900mm depth of foundation below E.G.L.
	Denotes minimum 1200mm depth of foundation below E.G.L.
	Denotes minimum 1500mm depth of foundation below E.G.L.
	Denotes minimum 1800mm depth of foundation below E.G.L.
	Denotes minimum 2100mm depth of foundation below E.G.L.
	Denotes minimum 2300mm depth of foundation below E.G.L.
	Denotes minimum 2500mm depth of foundation below E.G.L.
The above shaded areas denote minimum depth of Excavation below Existing/Original or Proposed Ground Level, whichever gives the greatest depth. This table is to be read in conjunction with Trenchfill foundation on clay sites notes and Trenchfill Foundation Depth Guide on drawing 5001.	

PILED GROUND BEAM / PILECAP NOTES

- A Soils Investigation Report has been carried out on 27th OCT. 2022 by LEAP ENVIRONMENTAL LTD. Additional investigations carried out on 29th APRIL 2025 by Sevenoaks Environmental Services.
- Concrete to be in accordance with BS EN 206-1, BS 500-1 and BS 500-2 and should be at minimum the following grades:
Location Designated Concrete Design Chem Class Consistency Class
Blinding GEN1 DS-1 AC-1 S3
Piling RC30/37 DS-1 AC-1 S4
Ground Beams RC32/40 DS-1 AC-1 S3
Pilecaps RC32/40 DS-1 AC-1 S3
Substruct Mortar M6 DS-1 AC-1
CFA piling not suitable for AC-5 Ground Design Chemical Class
- Pile loads shown are un-factored in Kilonewtons (kN). Piles shall be designed by the piling specialist in accordance with the requirements of the project specification and associated documents using recognised empirical formula and to the satisfaction of the checking authority. Design to include for 10kN lateral load/pile and to overcome the risk of ground heave.
- Maximum pile diameter to be 300mm and to be positioned centrally about ground beams unless noted otherwise, any variation from this diameter is to be notified to the Engineer immediately. Nursery & Apartments piles to be 400mm Dia.
- Bottoms of all foundation excavations shall be trimmed, levelled and protected from inclement weather and kept free of water. Bottoms of excavations to receive reinforced concrete, shall be blinded with not less than 50mm of designated concrete in accordance with the table above.
- The Contractor is responsible and liable for ensuring the stability of the works and services at all stages of construction. Unless shown on the project drawings, we have no knowledge of existing underground services or obstructions.
- All ground beams to be shuttered using MAX FRANK PECAFIL or equivalent permanent formwork unless ground conditions provide good stability of trench sides. Where foundations are cast against an earth face, increase foundation widths to achieve minimum 75mm cover.
- Reinforced concrete shall be compacted by means of a mechanical vibrating poker and the workability shall be such that, when compacted, a dense concrete, free from voids shall be produced.
- Construction joints in ground beams shall be formed against a vertical grout tight shutter and shall be located in the middle third of any beam span between piles, subject to being a minimum of 1.5m from any junction with other ground beams.
- Piles are to be left in a sound condition with the reinforcement projecting 40 x bar diameter above the stated cut off level. Pile reinforcement to be turned into ground beams cages and lapped with top reinforcement as shown on the drawings. Use a minimum of 6H16 bars having an anchorage length of 650mm into the pile concrete and a minimum lap length of 650mm with the top layer of ground beam reinforcement.
- Piles have been designed on a maximum deviation position of 75mm. Any piles out of position greater than 75mm to be reported to the Engineer immediately.
- Pile Head to have a minimum embedment of 50mm into ground beams and 75mm into Pile Caps.
- All Piles are to be cast a minimum of 300mm above their cut off level and then broken down to the levels indicated on the Pile Table.
- All piles to be 100% integrity tested. Provide one static load test to 1.5 x working pile load with F.O.S. of 2.5 or alternatively design for a F.O.S. of 3.0 with no static load test required subject to Local Authority and NHBC approval. Test pile to be nominated upon receipt of daily piling logs, by Engineer. Piling Contractor to include for the construction of all anchor piles for the static load test.
- The maximum vertical settlement of the pile is not to exceed 10mm, unless noted otherwise in the specification.
- For all crane base foundations, refer to crane suppliers drawings and details for links and stirrups to be cast into foundations.

Key	Description
	Indicates span of Beam and Block/PCC Floor.
	Denotes Step in underside of Foundation.
	Denotes Step in top of Foundation.
	Denotes minimum depth of foundation below E.G.L. U.N.O., Foundation depth to be a minimum of 900mm.
	External wall to be fully tied to internal wall at 225mm centres.
	Existing Ground Level
	Denotes Pilecap reference.
	Denotes Pile number
	All Tie Beams to be 300 x 300dp U.N.O.

TRENCHFILL FOUNDS ON CLAY SITES

- A Soils Investigation Report has been carried out on 27th OCT. 2022 by LEAP ENVIRONMENTAL LTD. Additional investigations carried out on 29th APRIL 2025 by Sevenoaks Environmental Services.
- Foundation depths shown on the drawings should be a minimum of 900 mm below existing or proposed ground level whichever gives the greatest depth and should penetrate all soft spots, made up or disturbed ground by a minimum of 150mm into undisturbed RIVER TERRACE DEPOSITS WITH UNDERLYING WEALD CLAY at depth with an allowable bearing pressure of 85 kN/m². A suitably qualified Engineer and/or Building Control/warranty provider inspector should be consulted to ensure that the correct bearing strata is achieved prior to casting foundation. Should the additional depth of foundation required to penetrate the founding strata exceed 500mm, the Engineer should be consulted before proceeding.
- Foundation depths are based on the greater of:
Depth to suit trees to remain as shown on the drawings.
Depth to suit trees to be removed as shown on the drawings.
Depths shown are to be measured from existing or final ground levels, whichever gives the lowest level, unless otherwise shown on the drawings.
- Foundation depths shall be increased as required to penetrate a minimum of 500mm below any root activity. Depths determined by this requirement shall not be less than those shown on the drawings.
- To ensure compliance with the Contractor with note 4, an appropriately qualified Engineer shall be employed to inspect excavated soil during the final 500mm of any excavation. This Engineer should break open clumps of soil excavated to examine the soil for roots. If in doubt, the design Engineer should be consulted before proceeding further with construction of the foundations.
- All foundations shall be constructed with a vertical face without the presence of any over break or concrete overspill. The Engineer is to be informed if such criteria are not met to agree appropriate remedial action.
- Foundation depths shown apply only to the location of buildings accounting for the presence of trees & shrubs shown on the drawings. Report to the Engineer if site conditions or details of trees / shrubs vary from information shown.
- All foundation depths have been derived in accordance with all existing trees indicated on the Arboricultural Report. All proposed planting and for all future planting on the site, the Client/Employer shall ensure that new tree or shrub planting is in compliance with the following requirements for MEDIUM volume change potential soil:

Water demand of tree (See NHBC Standards, Ch 4.2: Table 3)	No Tree or shrub planting zone for minimum foundation depth
High	1.25 x mature height (m)
Moderate	0.75 x mature height (m)
Low	0.50 x mature height (m)
Soil volume change (See note 8)	No Shrub Zone (m)
High	3.0 m
Medium	2.5 m
Low	2.0 m
- Foundations to each plot, or group of units shall bear onto consistent ground conditions throughout.
- Where foundations bear into non-shrinkable soils (such as sands and gravels) which are underlain by shrinkable clay, foundation depths may be varied to suit site conditions subject to the receipt of prior written approval of the Engineer and Local Authority.
- Where non-shrinkable soils (such as sands and gravels) underlie shrinkable clays, foundation depths may be varied to suit site conditions subject to the receipt of prior written approval of the Engineer and Local Authority.
- Sleeves / lintels etc. to allow drains and services to pass through foundations and substructure walls shall allow for the following potential ground heave:

Volume change potential (See note 3)	Potential Ground Heave
High	150 mm
Medium	100 mm
Low	50mm
- The Contractor is to ensure, so far as reasonably practical, that the client has obtained all necessary Building Regulations and/or similar approval before he commences work on site.
- The Contractor is responsible and liable for ensuring the stability of the works and services at all stages of construction. Unless shown on the project drawings, we have no knowledge of existing underground services or obstructions.
- Heaveguard should be provided to the inside face of perimeter Trenchfill foundations when deeper than 1500mm to a depth of 500mm above founding level when the heave potential is HIGH or MEDIUM (See note 8 above). See 4000 series drawings for details.
- Foundation concrete to be in accordance with BS EN 206-1, BS 500-1 and BS 500-2 and should be at minimum the following grades:
Location Designated Concrete Design Chem Class Consistency Class
Trenchfill GEN3 DS-1 AC-1 S4
Substr Mortar M6 DS-1 AC-1
Imposed loads 2.50 kN/m², Houses 1.50 kN/m².

PRECAST FLOOR CONSTRUCTION

- All design packages used for pre-cast concrete floor units shall be B.S.1. or agreement approved. Copies of relevant documentation shall be supplied to the Engineer on request.
- The pre-cast unit manufacturer shall supply the Engineer with 2 copies of all design calculations, drawings etc. (including reinforcement drawings for R.C. elements) and shall not proceed with manufacture until comments are received from the Engineer. Allow 5 working days for comments and programme works to comply with main contractors programme.
- All structural concrete design shall comply with BS 8110 and shall allow for the unfactored loadings listed below.

Self weight of floor units for ground floor construction to be not more than 300 kg/m². Self weight of floor units for upper floor construction to be not less than 300 kg/m² and not more than 340 kg/m². Screed and finishes load:- refer to Architects drawings for floor construction (allow screed weight 2400kg/m³).

Timber floating floor and finishes load - 1.80 kN/m².

Imposed loads
Garages 2.50 kN/m², Houses 1.50 kN/m².

Partitions
UDL 0.50 kN/m².
Line load for non-loadbearing partitions: Timber 2.00 kN/m, Masonry 3.00 kN/m run.
- Where beam and block floor systems are used, air bricks to ventilate the under floor voids shall not be located under beam bearings.
- All concrete units to have nominal 90mm (min. 75mm) bearings on structural steelwork sections and nominal 100mm (min. 90mm) bearings on masonry except where shown otherwise on the drawings.
- Where the sides of precast units are built into walls, pin up hard between wall and underside of unit with 1:3 cement:sand mortar to ensure structural continuity.
- All concrete infill between hollow plank units and for closing up of holes around services etc., not to be less than grade C28/35 for 6mm aggregate, S3 slump to BS EN 206-1, BS 8500-1 and BS 8500-2.
- Grouting of units shall be in strict accordance with manufacturer's instructions.
- External and party walls parallel with beam span shall be restrained at top of upper floor levels with galvanised 30x5.0mm straps having a size not less than 100x1000 and at no more than 2.0m centres in housing and 1.25 centres in flats.
- PCC planks to be designed to suit holes and notches as detailed on the drawings. Floor supplier to include for trimming around service holes, except as detailed on the drawings.
- Contractor/PCC Plank Supplier to submit erection sequence of planks prior to construction. When using Slimfloor, ASB, beams with web angles or with bottom plates to support PCC, steelwork should always be loaded evenly on both sides during construction.

GENERAL NOTES

- The drawings, design and all information contained therein are the sole copyright of Richard Jackson Ltd and reproduction in any form is forbidden unless permission is obtained in writing.
- All drawings shall be read in conjunction with all relevant Civil / Structural Engineers drawings, the project specification and Architects, Services Engineers & Landscape Architects drawings.
- For all setting out information, D.P.M., D.P.C., Finishes and waterproofing details refer to the Architects drawings and details.
- The Contractor shall verify all site and setting out dimensions before putting work in hand. Where dimensions are shown on the Engineers drawings, any discrepancies shall be reported to him.
- Dimensions must not be scaled from the Engineers drawings.
- All dimensions are in millimetres unless noted otherwise.
- Dimensions marked * are subject to confirmation by site measurement before construction proceeds.
- All dimensions are given to structural surfaces unless noted otherwise.
- All lightning connectors to be fixed in accordance with specialist details.
- No holes, chases, cut-outs, existing or proposed services or the like may be formed in or pass through any beam, column, or load bearing wall unless written permission is obtained from the Engineer.
- Holes smaller than 225 x 225mm through slabs are not necessarily shown on the Engineers drawings.
- For size and location of all services refer to the Service Engineers and Architects drawings.
- Inspections made by the Local Authority, NHBC or other Statutory bodies, shall be arranged by the Contractor to suit his programme. Any costs arising out of failing to carry out the work to the satisfaction of the Checking Authority will be the sole responsibility of the Contractor.
- Non-structural fixings are generally not shown on the Engineers drawings and if any such detail is indicated it must be confirmed by cross-reference to other specialists before construction.
- All drawing specifications are given in accordance with NBS (National Building Specification) e.g. E10/130 which refers to NBS Section E10, Clause 130.
- Abbreviations:

CRS	Centres	TOC	Top of concrete
TBC	To be confirmed	BOC	Bottom of concrete
UNO	Unless noted otherwise	SSL	Structural slab level
DIA	Diameter	TOS	Top of steel
EGL	Existing Ground Level	FFL	Finished Floor Level
FGL	Finished Ground Level	SOP	Setting out point

ALL TRENCHFILL FOUNDATIONS TO BE **450mm** WIDE AND CENTRALLY LOCATED BENEATH WALLS UNO

ALL PILED FOUNDATIONS TO BE **450w x 450dp** AND CENTRALLY LOCATED BENEATH WALLS UNO. ALL TIE BEAMS TO BE **300w x 300dp** UNO

Rev	Date	Description	Drawn	Chkd
C01	28.07.25	CONSTRUCTION ISSUE	MP	PC
T3	14.07.25	TRENCHFILL FOUNDATIONS AMENDED TO PILED FOUNDATIONS. SOFT JOINTS INDICATED WHERE NEEDED AND ADDED TO KEY. NOTES REVISED AS CLOUDED	MP	PC
T2	09.05.25	SCREEN WALL LOCATIONS ADDED. MINOR FOUNDATION LEVELS AMENDED.	AMJ	PC
T1	28.03.25	ISSUED FOR TENDER PURPOSES	AMJ	PC
Rev	Date	Description	Drawn	Chkd

REVISIONS

This drawing is to be read in conjunction with all other Engineer's drawings and all other project information. Any discrepancy between the Engineer's drawings and other project information is to be reported to the Engineer immediately.



Project

COURT LANE NURSERIES
HADLOW, KENT

Drawing Title

FOUNDATION GA
SHEET 7

Client

dandara

Richard Jackson Engineering Consultants		Tel: 01206 228800	
847 The Crescent, Colchester, Essex, CO4 9YQ		Tel: 020 7448 9910	
6th Floor, 1 St. Katherine's Way, London, E1W 1UN		Tel: 01223 314994	
Julian House, Hill Lane, Sawston, Cambridgeshire, CB22 3HZ		Tel: 01603 230240	
6 The Old Church, St Matthews Rd, Norwich, Norfolk, NR1 1SP		Tel: 01172 020070	
New World Business Centre, Station Rd, Warrimley, Bristol, BS50 8XG		Tel: 01172 020070	
Email Address: mail@rj.co.uk		Web Site: http://www.richardjackson.co.uk	
Scale	Drawn	Date	RJL Project No
1 : 100	AMJ	28.07.25	62926
Project Manager	Checked	Approved	Security Code
L. GREENAWAY	PC	PC	574
Status	Suitability Description		
A4	AUTHORISED & ACCEPTED (CONSTRUCTION)		
Drawing Number		Revision	
LN41	RJL	00	FN DR S 0107 C01